



- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (T2) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (D1) Kältemittelinlass Ø28 / Refrigerant Inlet Ø28
- (D2) Kältemittelauslass Ø35 / Refrigerant Outlet Ø35

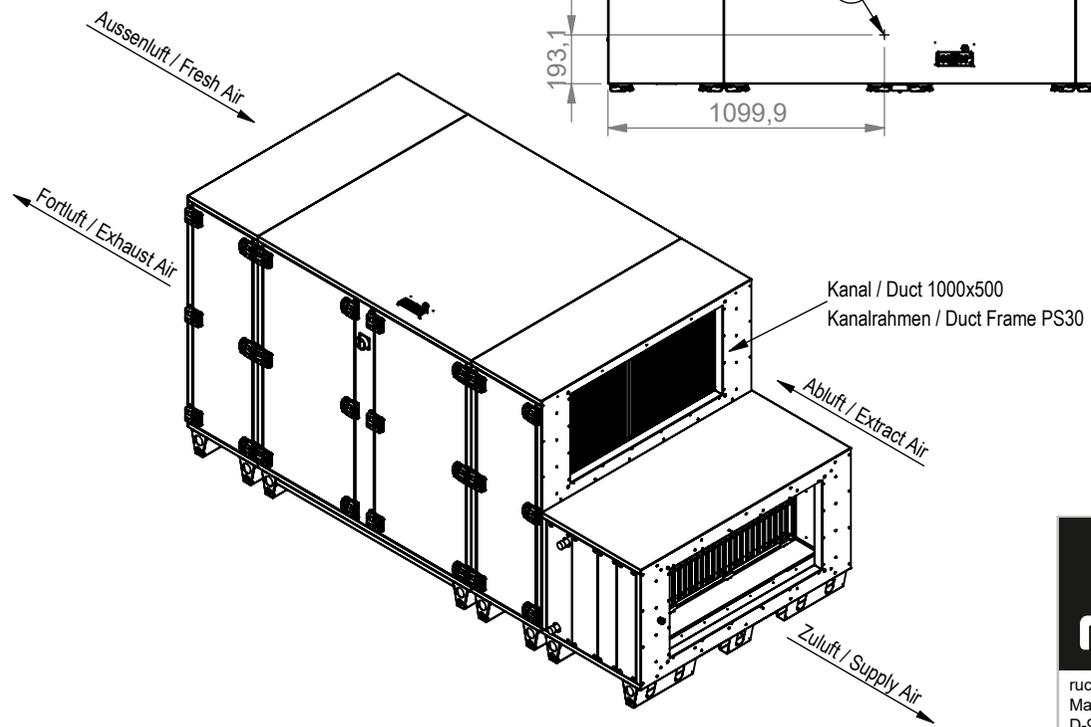

ruck
ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Protection Mark
according to ISO16016

Created d.ursu 26.06.2023
Drawn d.ursu 26.06.2023
Released a.ganea 06.03.2025
Disabled

General tolerances
DIN ISO 2768-c

ETAK4200HODJRT

168193 00