


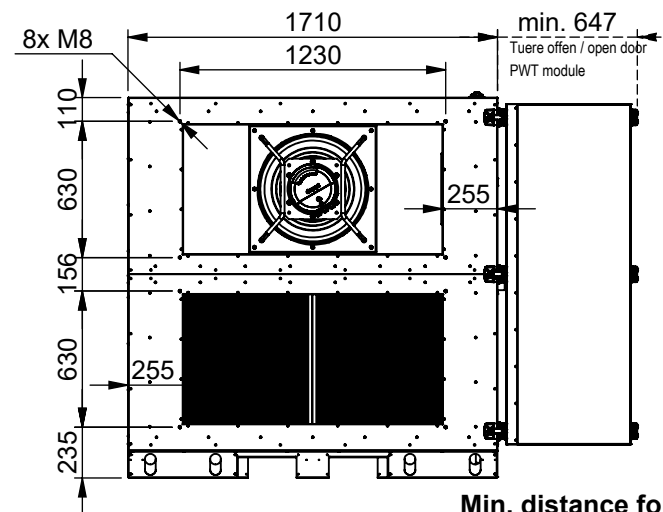
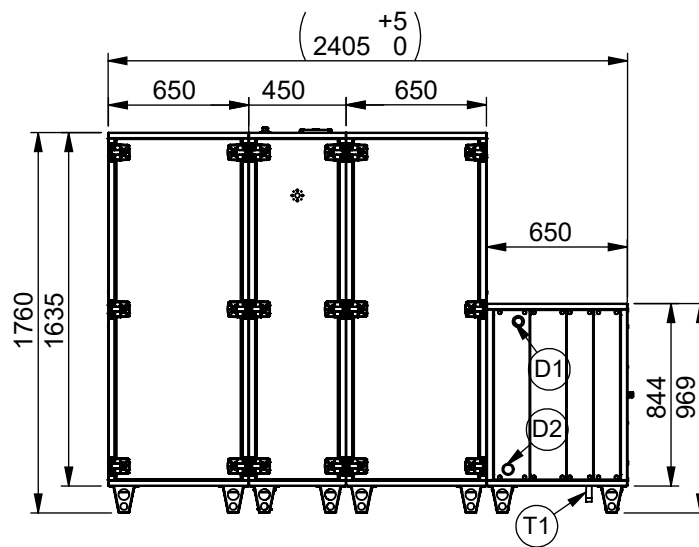
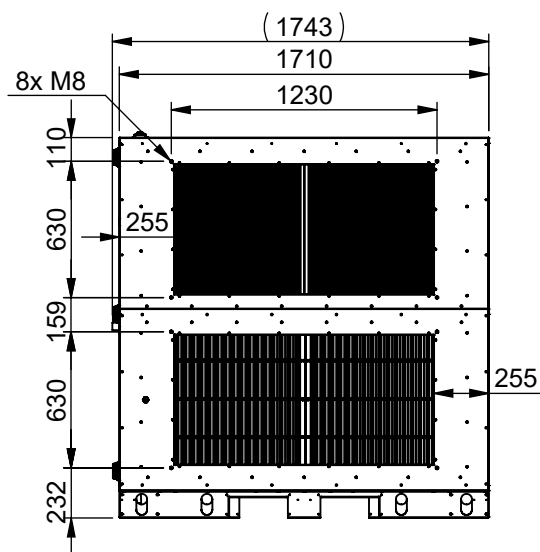


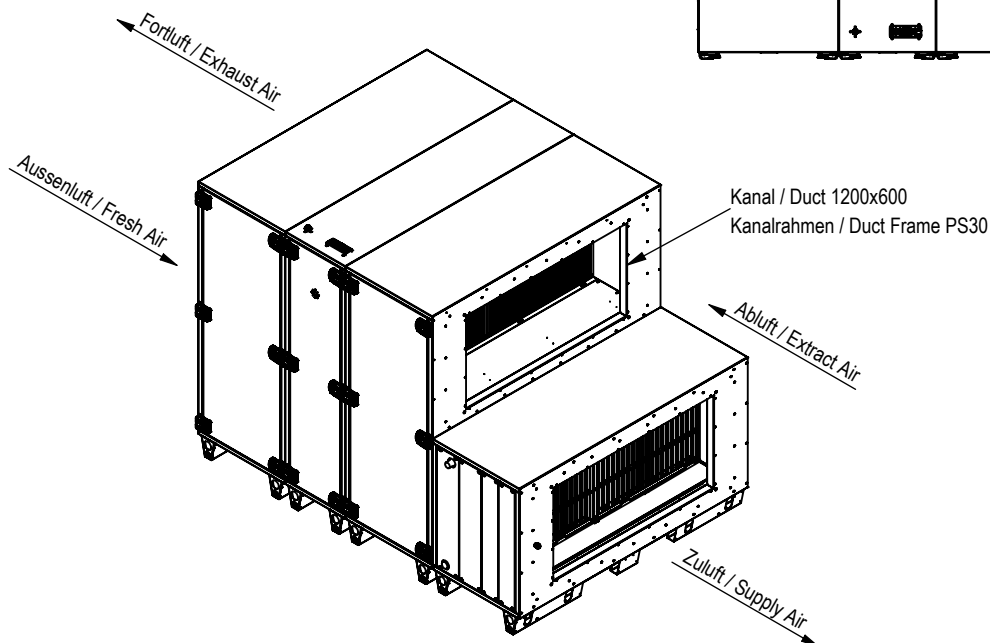

Min. distance for
changing the
filter 800mm !!!

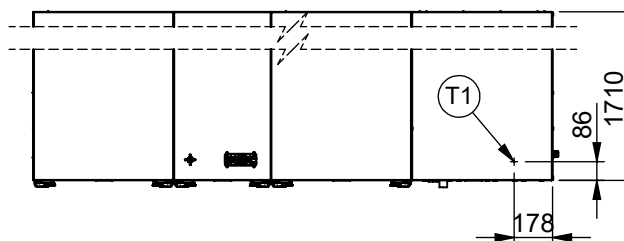

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (D1) Kältemiteleinlass Ø 35 / Refrigerant Inlet Ø 35
- (D2) Kältemittelauslass Ø 42 / Refrigerant Outlet Ø 42



Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

Created I.benk
Drawn I.benk
Released
Disabled

14.10.2025
14.10.2025

ROTK10000HODJRT

177333 00

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg