

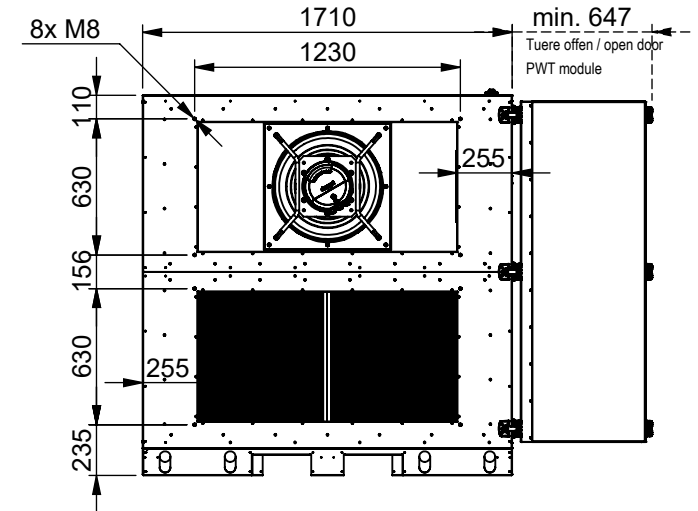
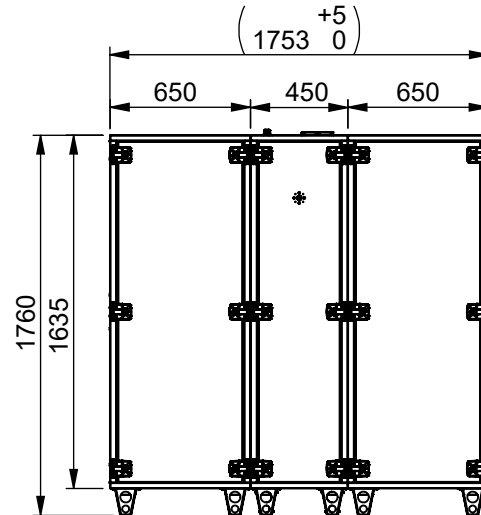
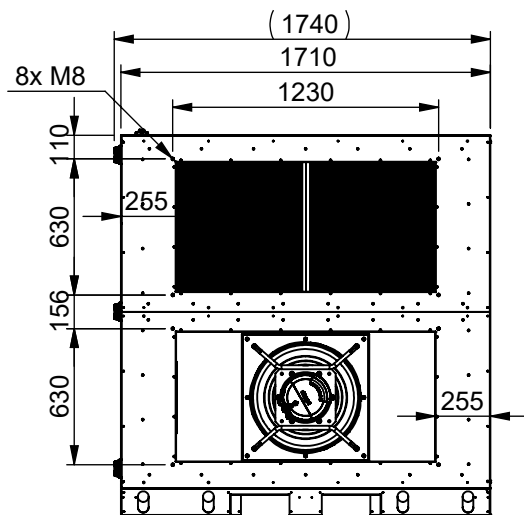



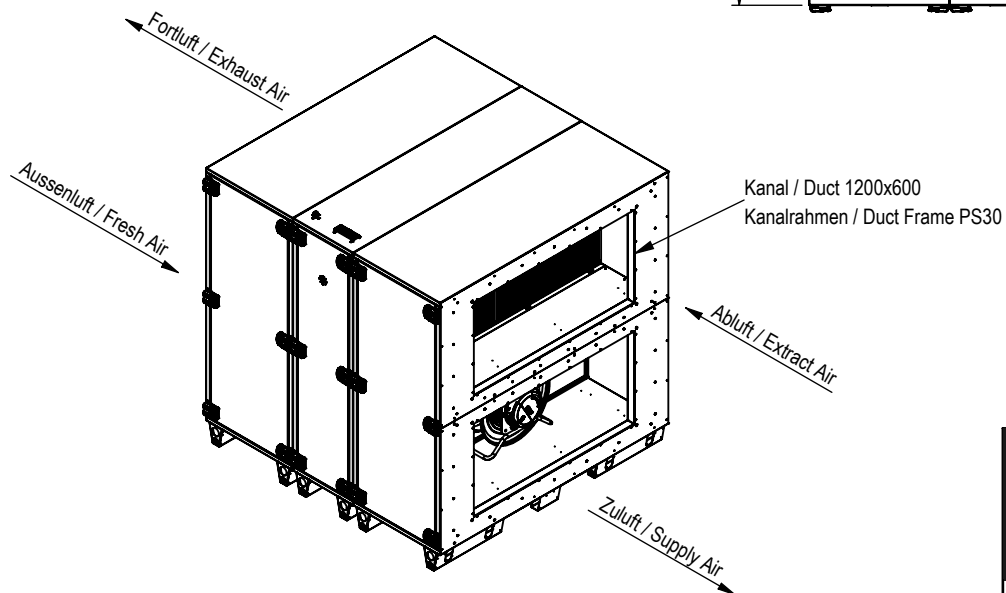

**Min. distance for
changing the
filter 800mm !!!**

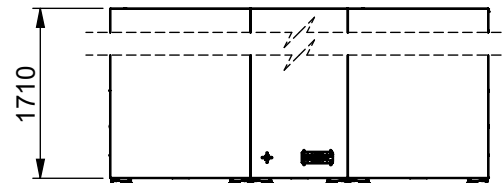

Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ROTK10000HOOJRT

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created I.benk
Drawn I.benk
Released
Disabled

14.10.2025
14.10.2025

177329 00