


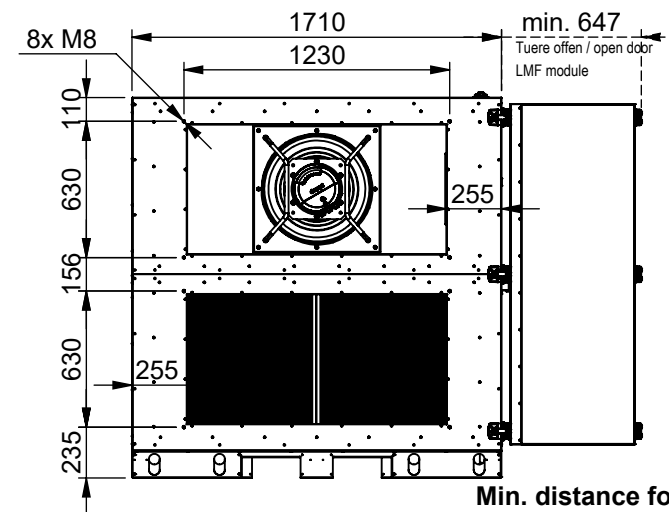
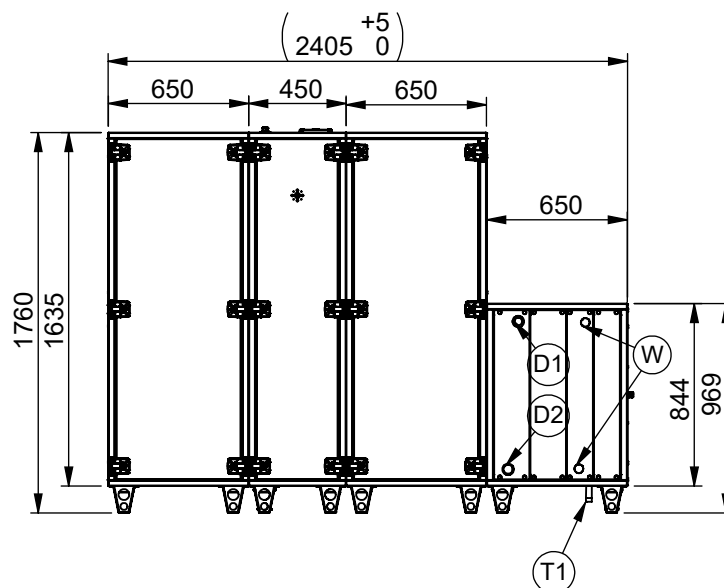


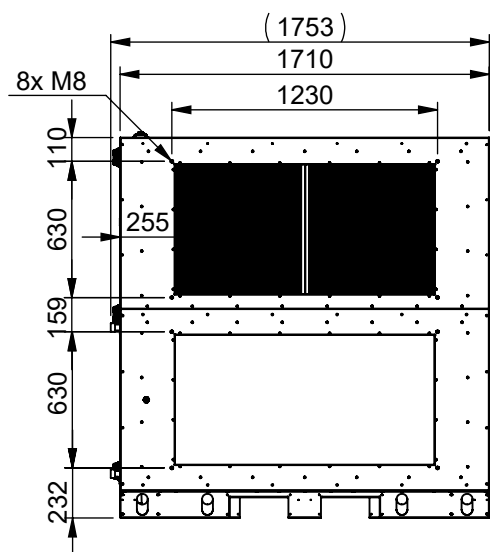

**Min. distance for
changing the
filter 800mm !!!**

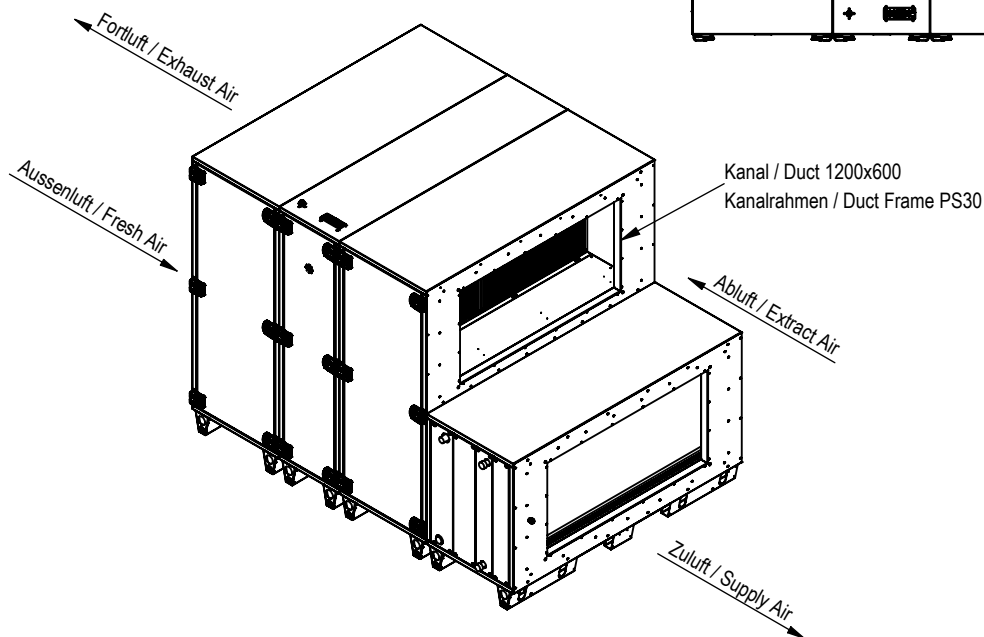

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 3/4" Aussengewinde / Connection 3/4" male tread
- (D1) Kältemittelinlass $\varnothing 35$ / Refrigerant Inlet $\varnothing 35$
- (D2) Kältemittelauslass $\varnothing 42$ / Refrigerant Outlet $\varnothing 42$

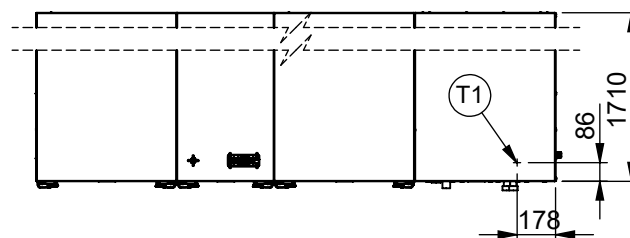

Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ROTK10000HWDJRT01

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created I.benk 14.10.2025
Drawn I.benk 14.10.2025
Released I.benk 28.11.2025
Disabled

177332 00