

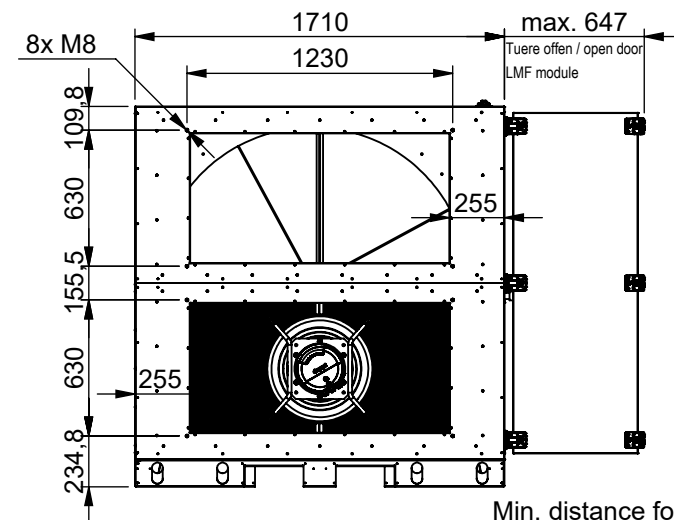
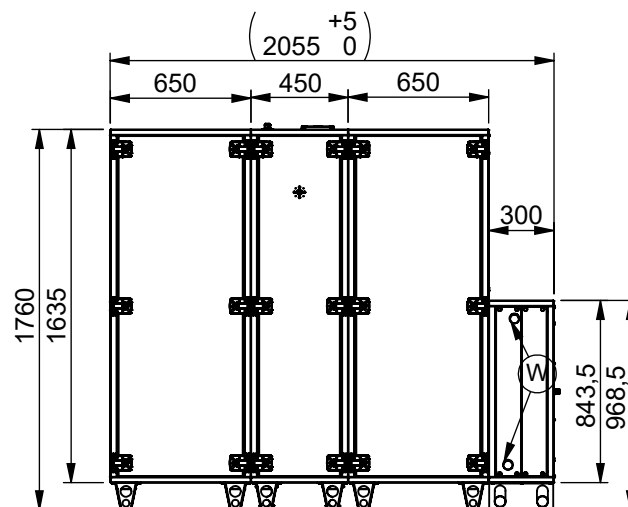
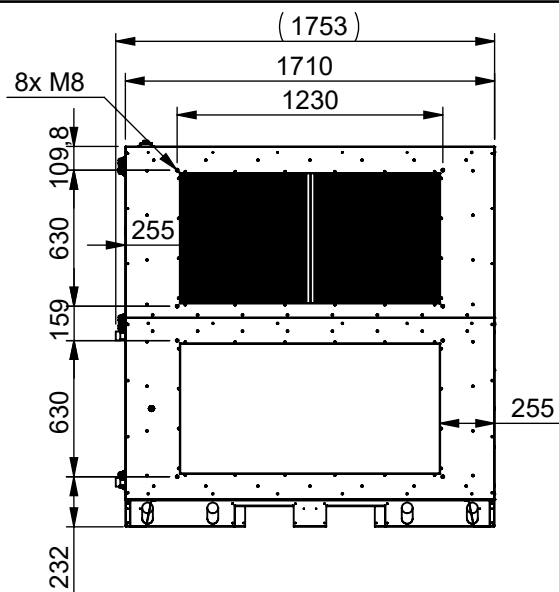


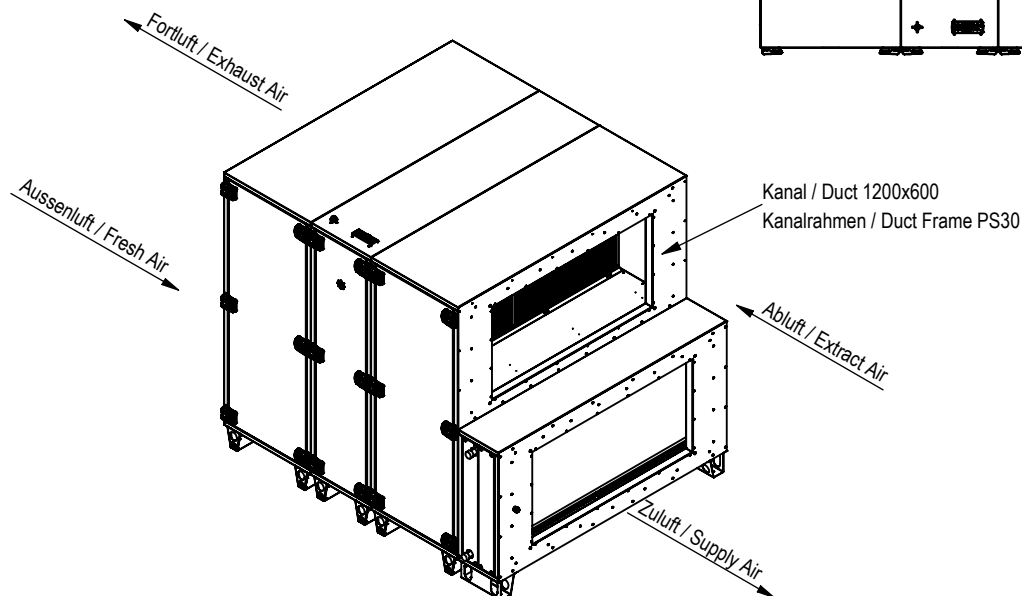

Min. distance for changing the filter 800mm !!!

(W) Anschluss 1" Aussengewinde / Connection 1" male tread

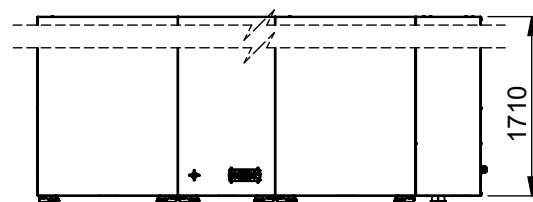

Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ROTK10000HWOJRT01

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created I.benk
Drawn I.benk
Released I.benk
Disabled

14.10.2025
14.10.2025
28.11.2025

177330 00