

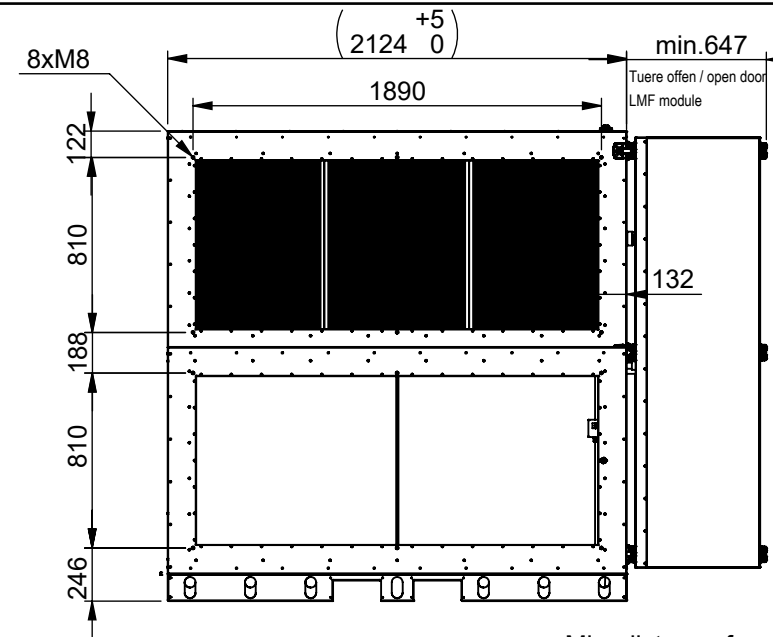
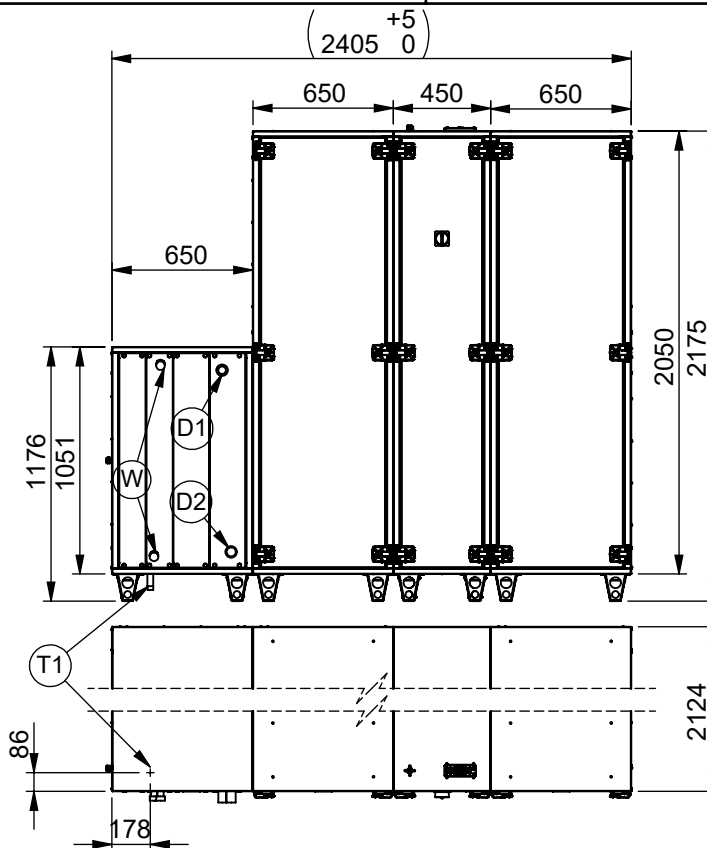
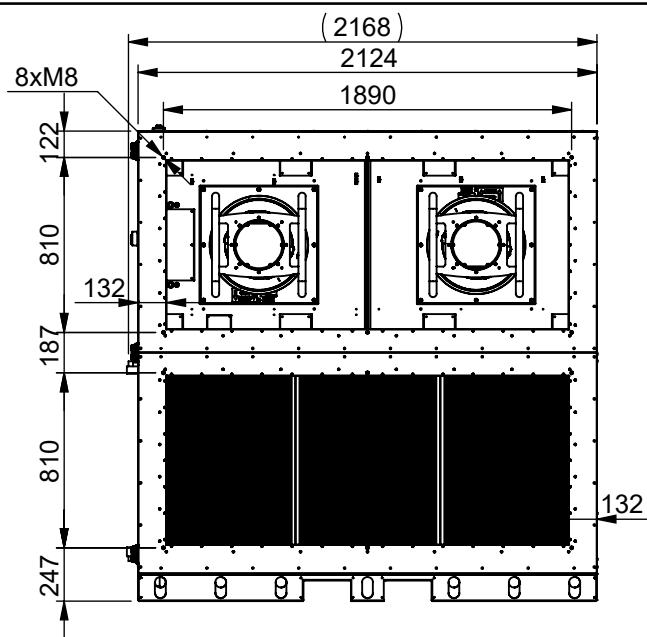




Min. distance for changing the filter 680mm !!!

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 1" Aussengewinde / Connection 1" male tread
- (D1) Kältemittelleinlass Ø 35 / Refrigerant Inlet Ø 35
- (D2) Kältemittelauslass Ø 42 / Refrigerant Outlet Ø 42

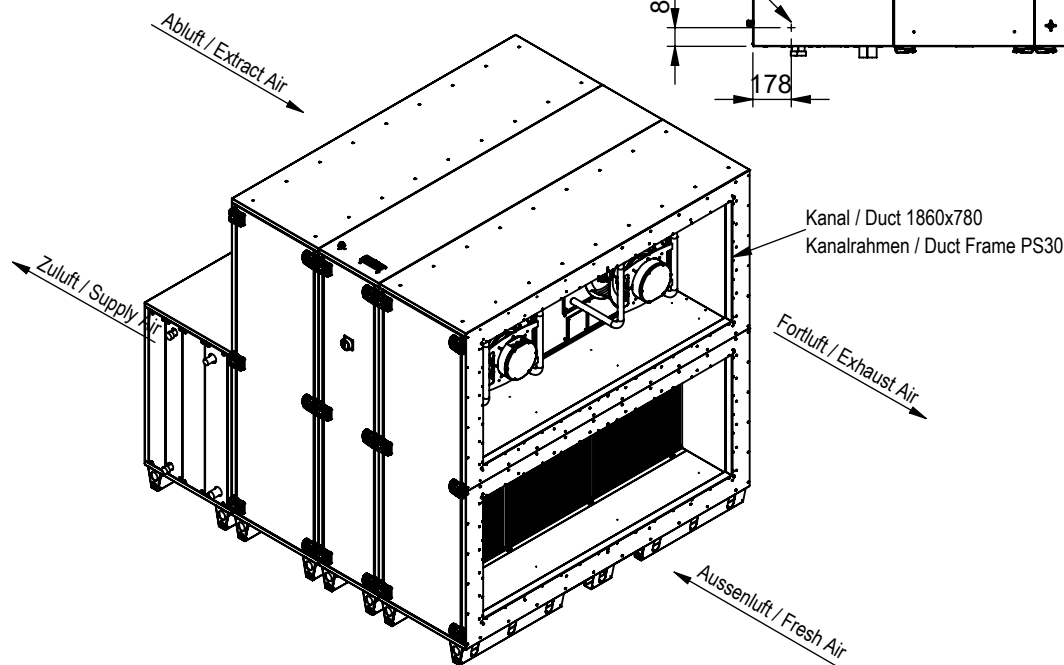

Protection Mark
according to ISO 16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ROK16000HWDJLT01

Created I.benk
Drawn I.benk
Released I.benk
Disabled

08.10.2025
08.10.2025
10.12.2025

177275 00

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg