

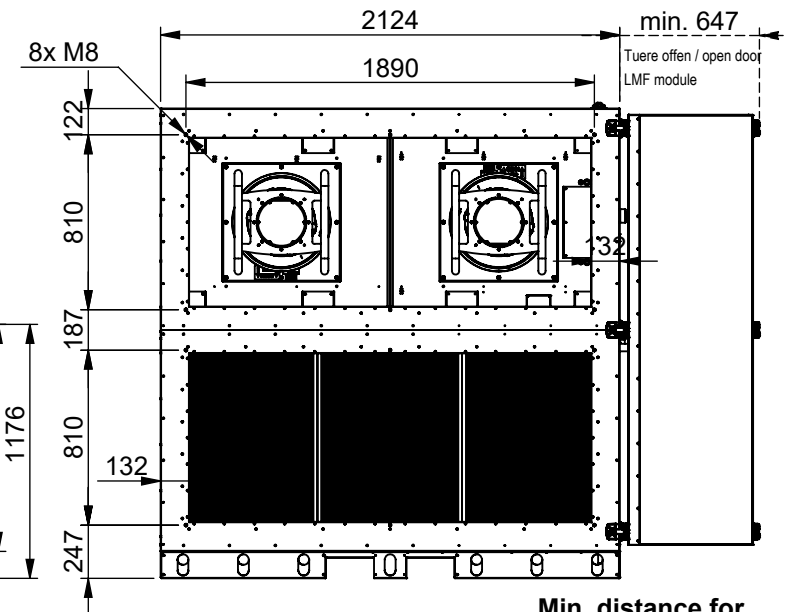
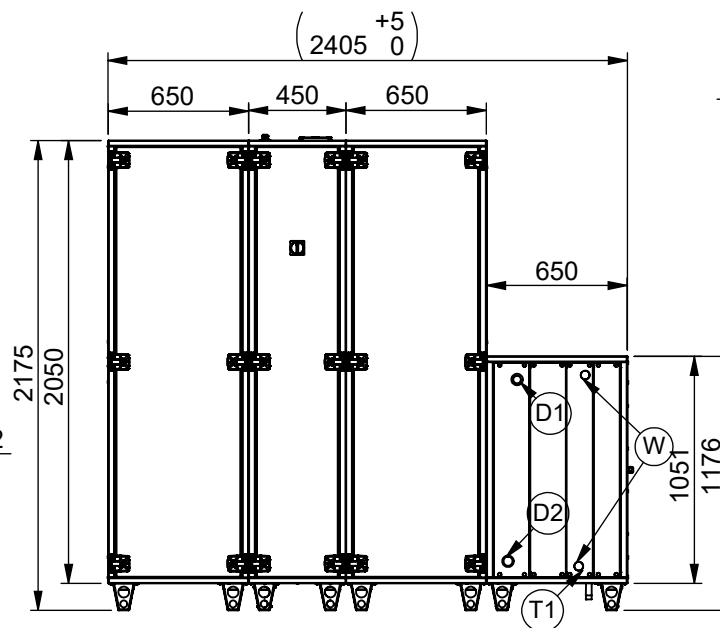
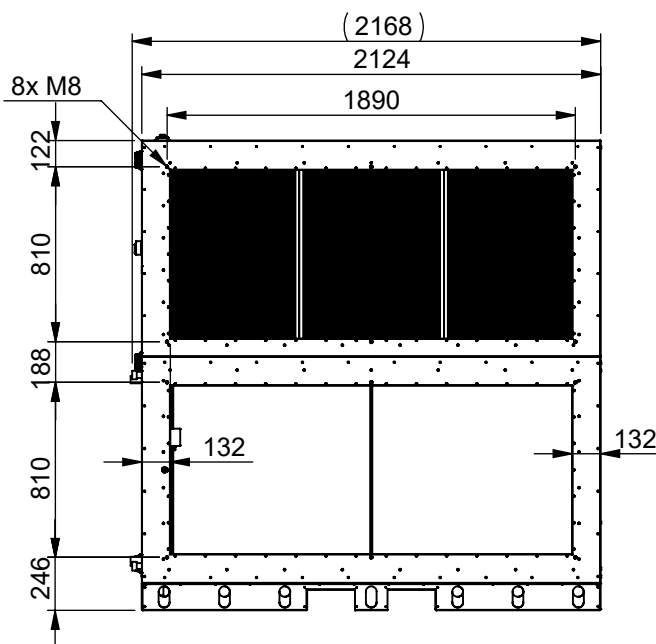


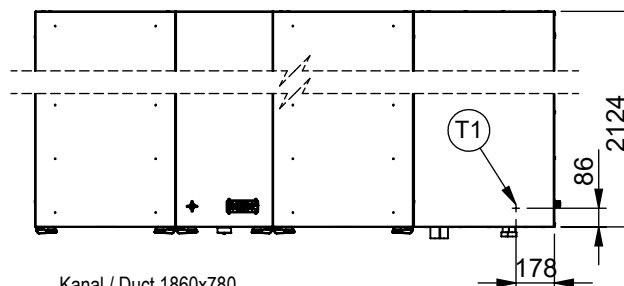

**Min. distance for
changing the
filter 680mm !!!**

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 3/4" Aussengewinde / Connection 3/4" male tread
- (D1) Kältemittelinlass $\varnothing 35$ / Refrigerant Inlet $\varnothing 35$
- (D2) Kältemittelauslass $\varnothing 42$ / Refrigerant Outlet $\varnothing 42$

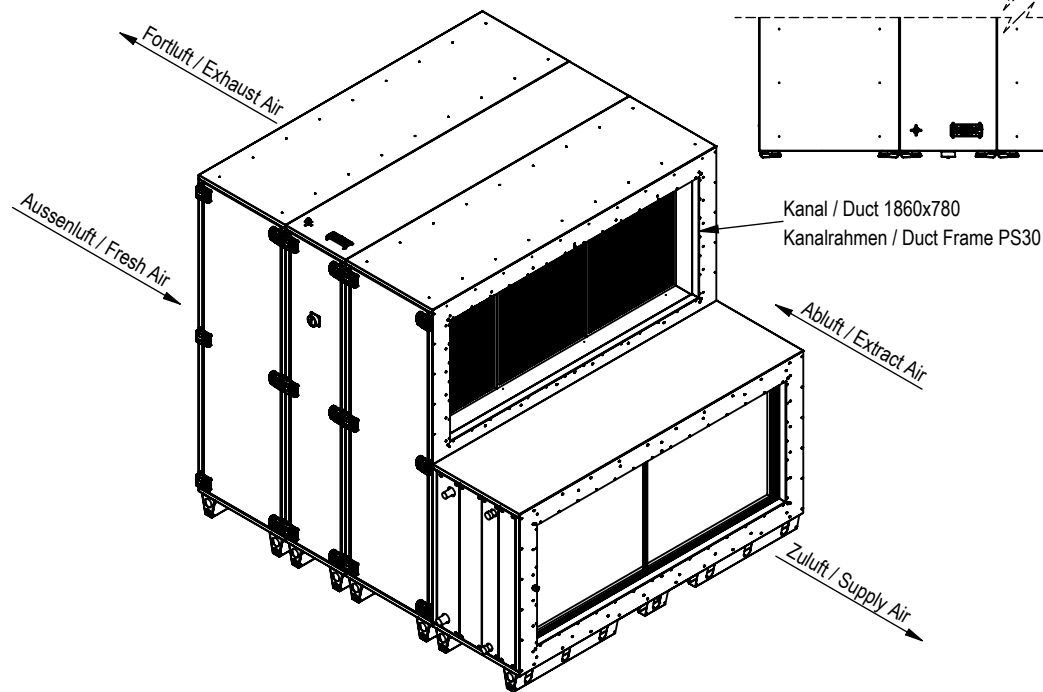

Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ROTOK16000HWDJRT01

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created I.benk
Drawn I.benk
Released I.benk
Disabled

08.10.2025
08.10.2025
09.12.2025

177270 00