

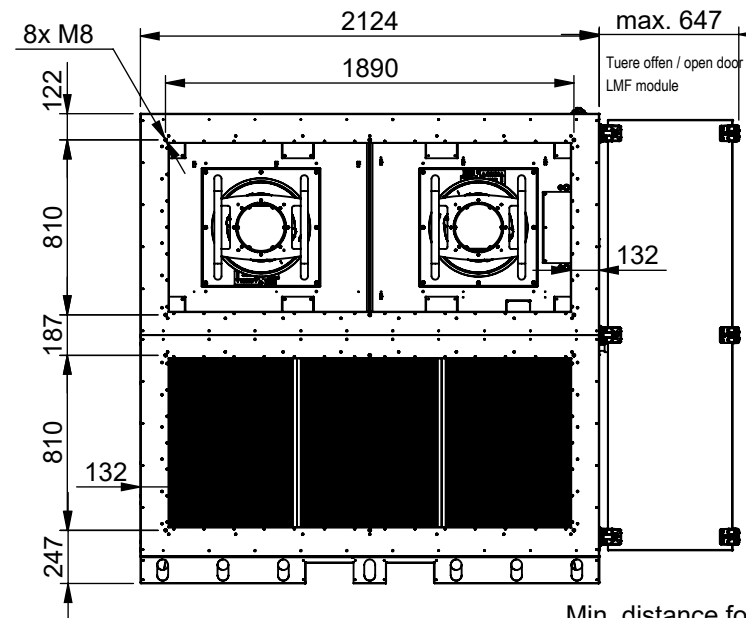
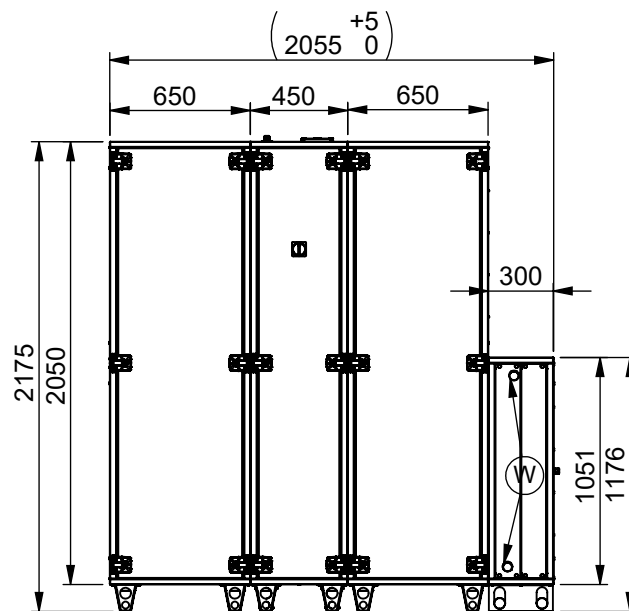
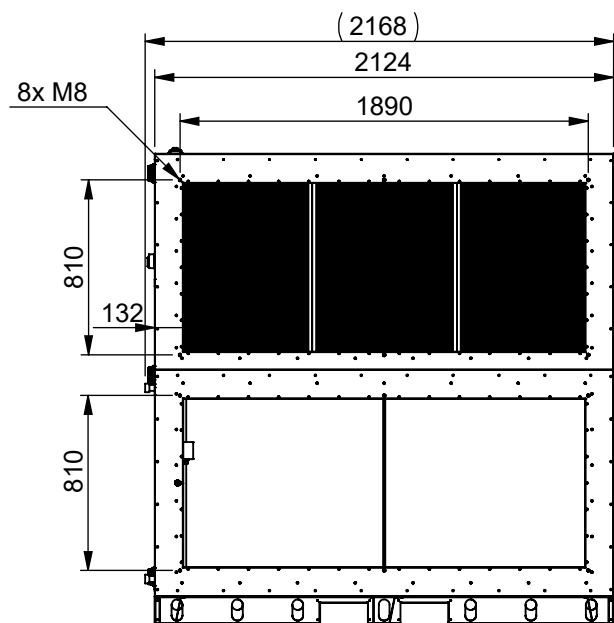


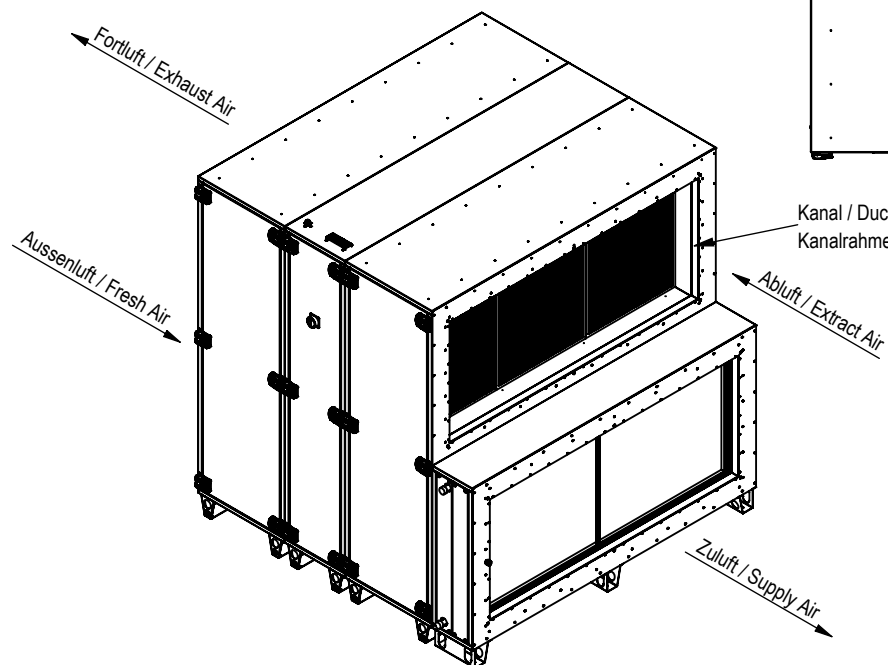


Min. distance for
changing the
filter 680mm !!!

(W) Anschluss 1" Aussengewinde / Connection 1" male tread

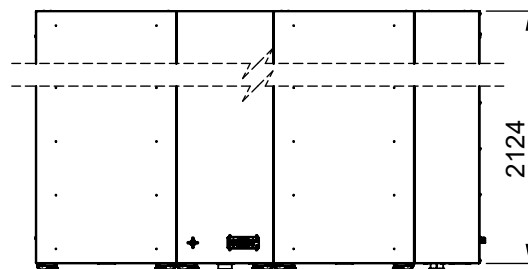

Kanal / Duct 1860x780
Kanalrahmen / Duct Frame PS30



Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ROKOK16000HWOJRT01

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created I.benk 07.10.2025
Drawn I.benk 07.10.2025
Released I.benk 09.12.2025
Disabled

177268 00