
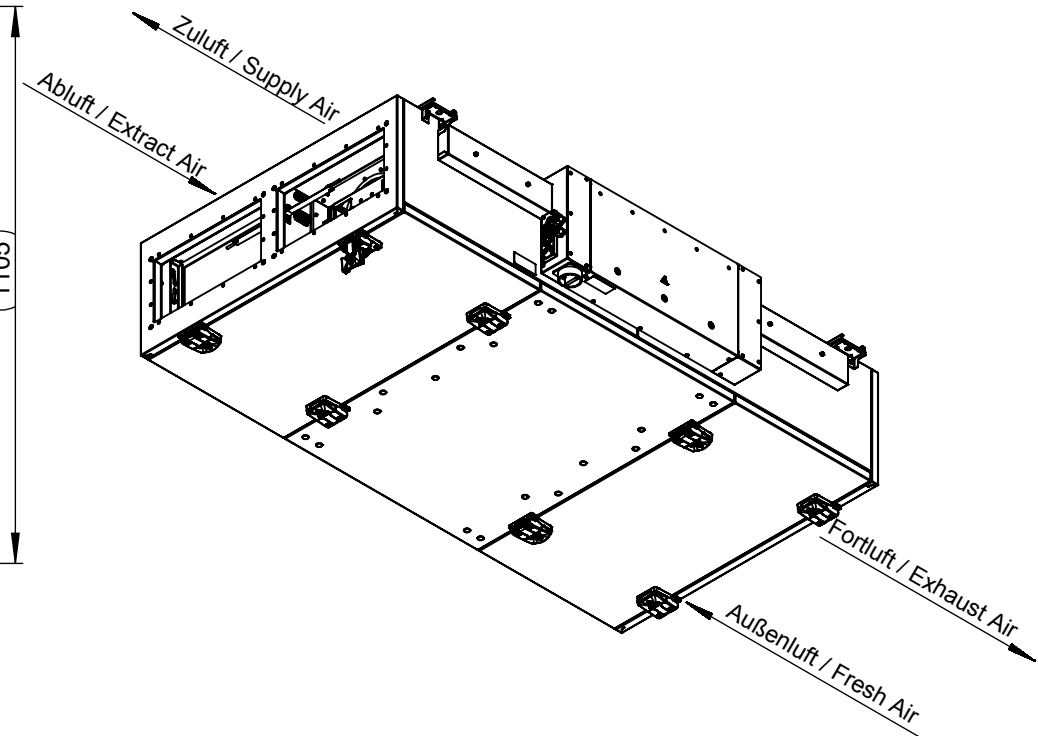
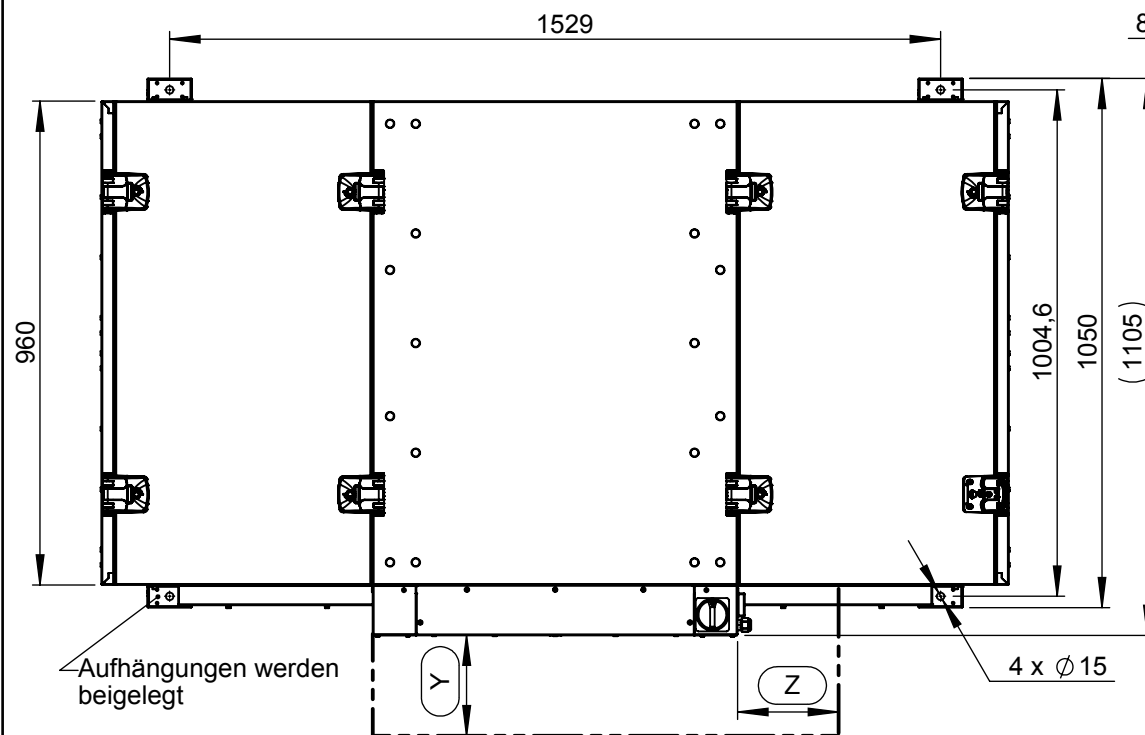
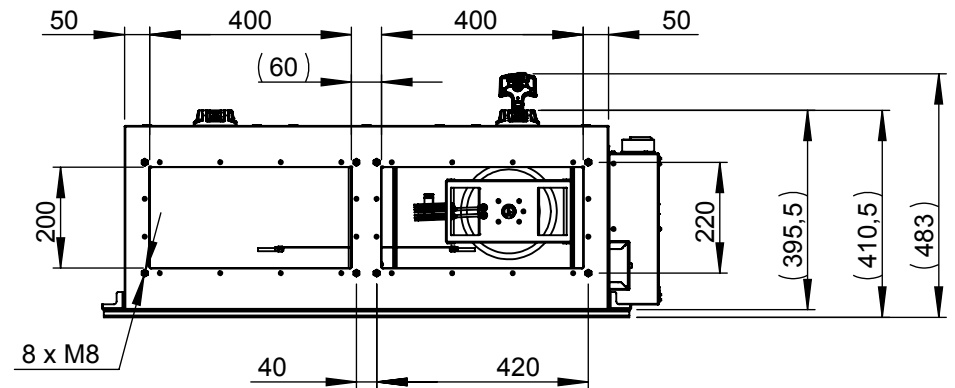


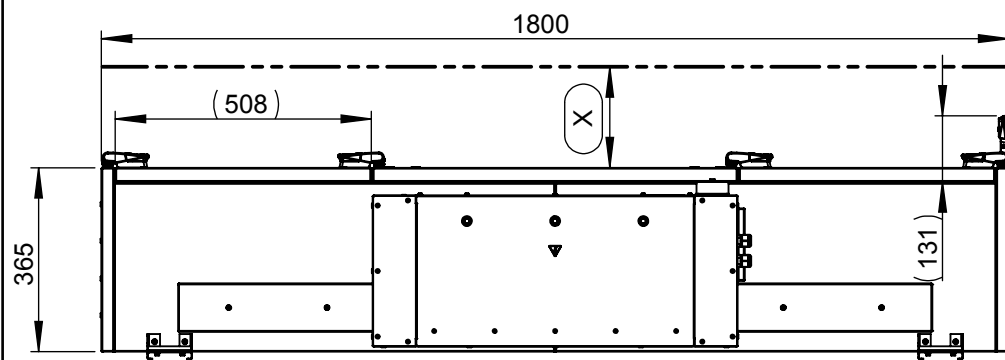


... = benötigte Freiräume:

X	Tür abnehmen	min. 170 mm
X	Tür aufklappen	min. 600 mm
X	Filter entnehmen	min. 310 mm
Y	elektrischer Anschluss	min. 100 mm empf. 300 mm
Z	Anschlußkabel	min. 200 mm

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO 16016

Created h.ragowski
Drawn h.ragowski
Released h.ragowski
Disabled

1:15 A4 mm

General tolerances
DIN ISO 2768-c

ACCUK600FOOJL

143043 01