


Kondensatablauf 3/4"
 Außengewinde
 Drain 3/4"
 male thread

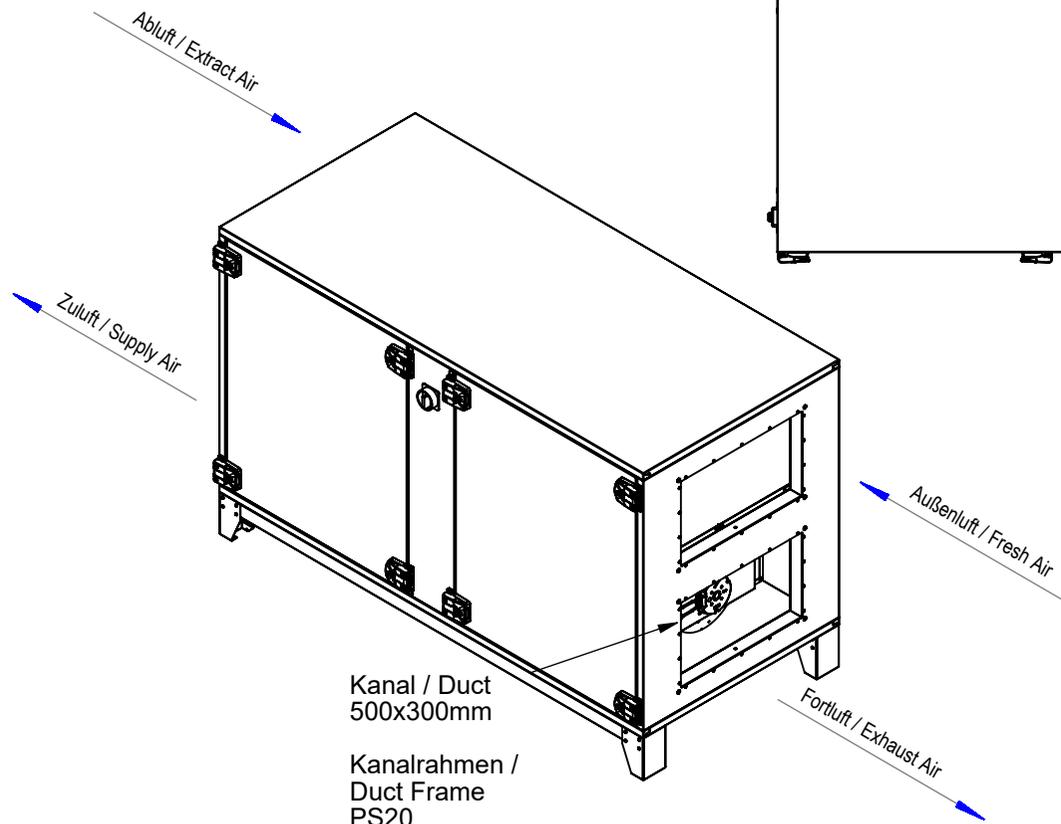

1:22 A4 mm

Protection Mark
 according to ISO16016

General tolerances
 DIN ISO 2768-c

ETAK1300HOOJL

Created a.ganea
 Drawn a.ganea
 Released a.ganea
 Disabled

06.10.2025
 06.10.2025
 06.10.2025

177237 00

ruck
 ruck Ventilatoren
 Max-Planck-Str. 5
 D-97944 Boxberg