

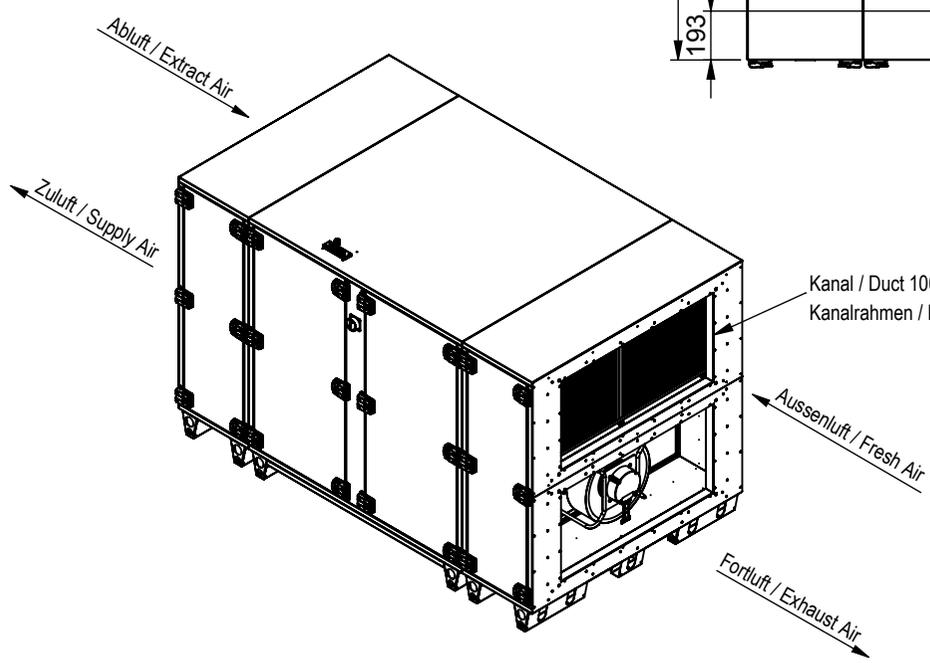


T1 Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male thread

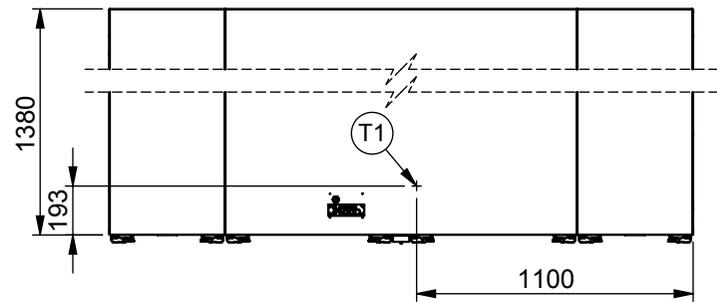

ruck
 ruck Ventilatoren
 Max-Planck-Str. 5
 D-97944 Boxberg

Protection Mark according to ISO16016
 Created d.ursu 05.07.2023
 Drawn d.ursu 05.07.2023
 Released d.ursu 06.07.2023
 Disabled

General tolerances
 DIN ISO 2768-c

ETAK4200HOOJLT

168365 00