

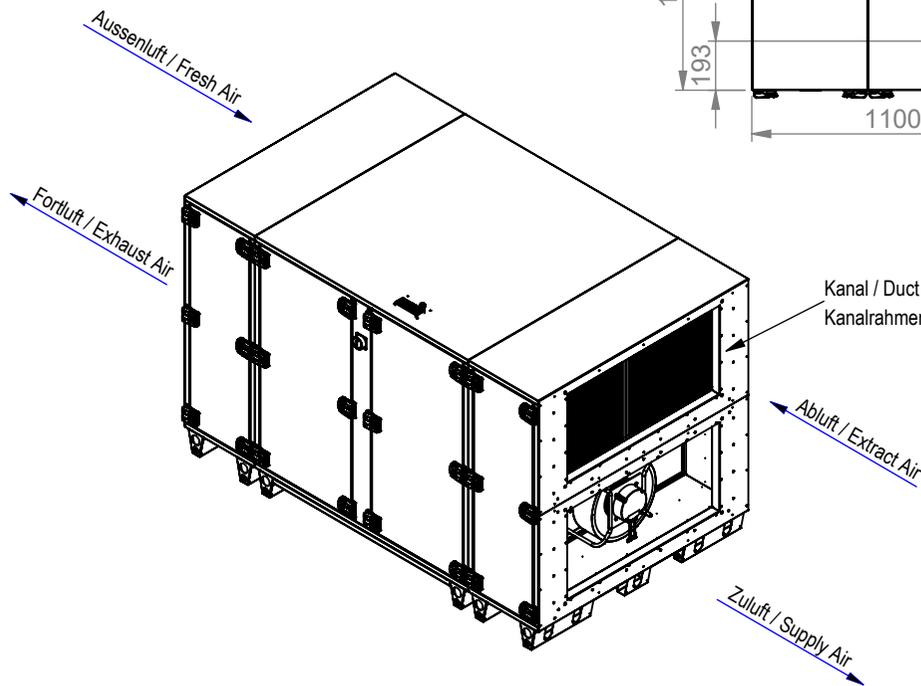


T1 Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread

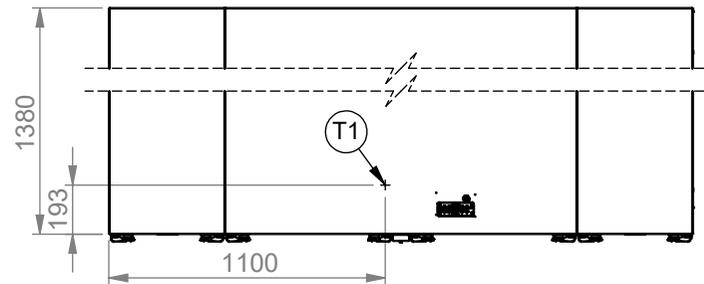

Kanal / Duct 1000x500
Kanalrahmen / Duct Frame PS30



Protection Mark according to ISO16016

Created d.ursu
Drawn d.ursu
Released a.ganea
Disabled

1:30 A4 mm

General tolerances
DIN ISO 2768-c

26.06.2023
26.06.2023
06.03.2025

ETAK4200HOOJRT

168189 00

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg