



- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (T2) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 3/4" Aussengewinde / Connection 3/4" male tread
- (K) Anschluss 1" Aussengewinde / Connection 1" male tread

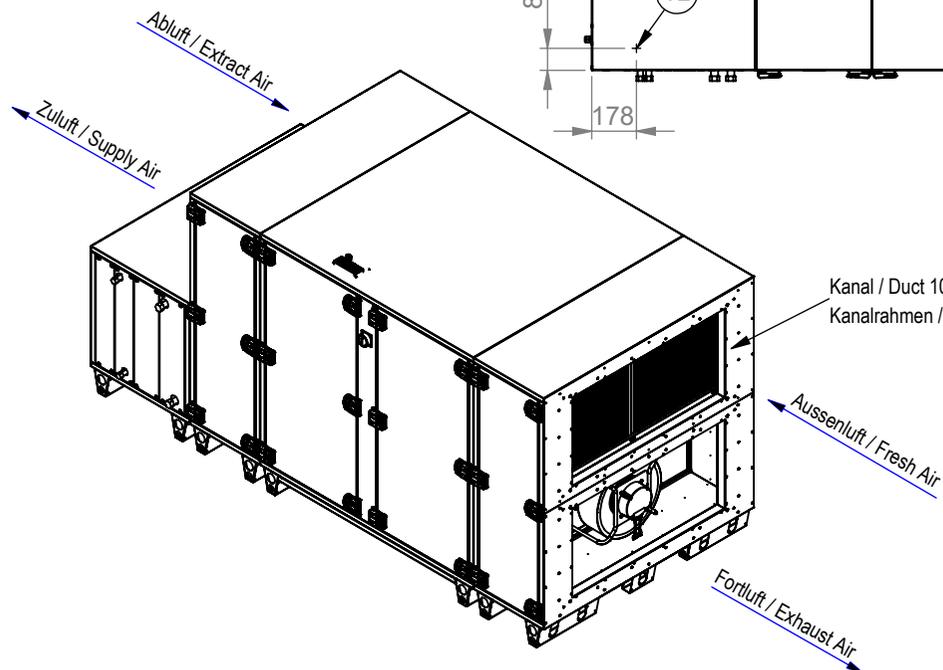

1:30 A4 mm

Protection Mark according to ISO16016

General tolerances DIN ISO 2768-c

Created d.ursu  
 Drawn d.ursu  
 Released a.ganea  
 Disabled

06.07.2023  
 06.07.2023  
 07.03.2025

**ETAK4200HWKJLT**

**168368 00**

**ruck**

ruck Ventilatoren  
 Max-Planck-Str. 5  
 D-97944 Boxberg