



- T1 Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- W Anschluss 3/4" Aussengewinde / Connection 3/4" male tread

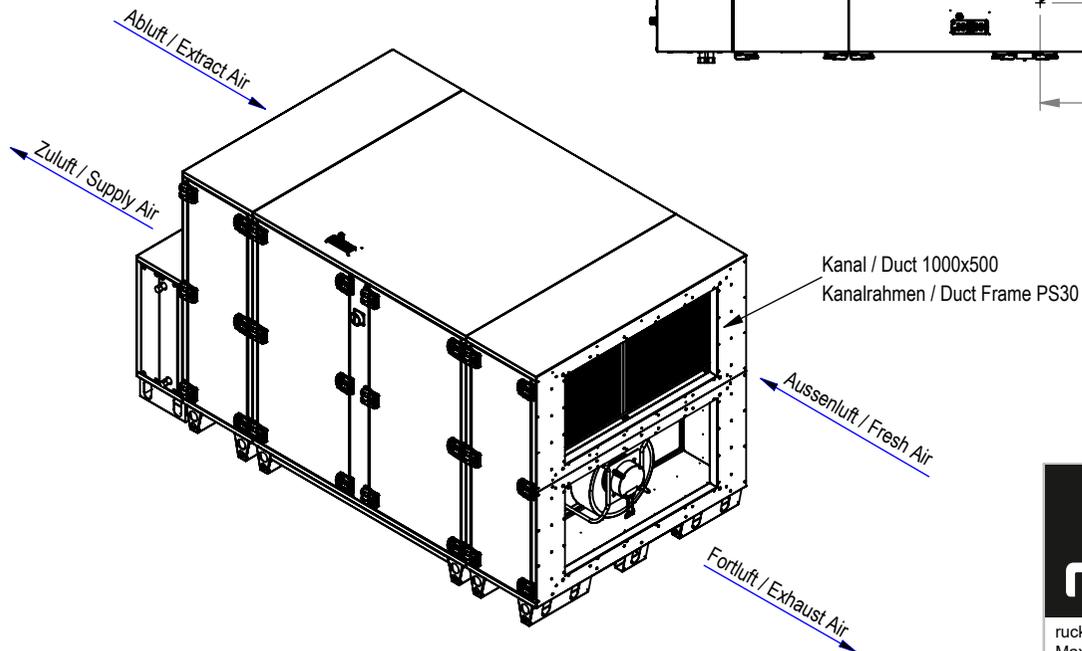

1:30 A4 mm

**ruck**

Protection Mark  
according to ISO16016

General tolerances  
DIN ISO 2768-c

**ETAK4200HWOJLT**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg

Created d.ursu  
Drawn d.ursu  
Released a.ganea  
Disabled

05.07.2023  
05.07.2023  
06.03.2025

**168366 00**