



- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (T2) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 3/4" Aussengewinde / Connection 3/4" male tread
- (K) Anschluss 1" Aussengewinde / Connection 1" male tread

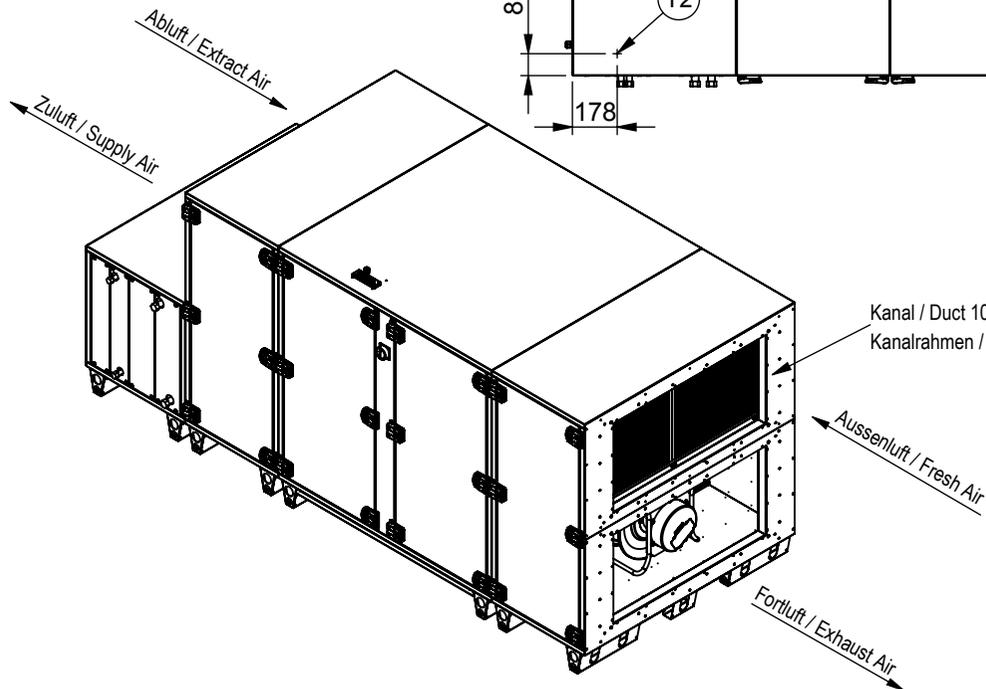

1:30 A4 mm

Protection Mark according to ISO16016

General tolerances according to DIN ISO 2768-c

Created d.ursu  
 Drawn d.ursu  
 Released d.ursu  
 Disabled

12.07.2023  
 12.07.2023  
 12.07.2023

**ETAK5000HWKJLT**

**168437 00**

**ruck**

ruck Ventilatoren  
 Max-Planck-Str. 5  
 D-97944 Boxberg