



- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (T2) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 3/4" Aussengewinde / Connection 3/4" male tread
- (K) Anschluss 1" Aussengewinde / Connection 1" male tread

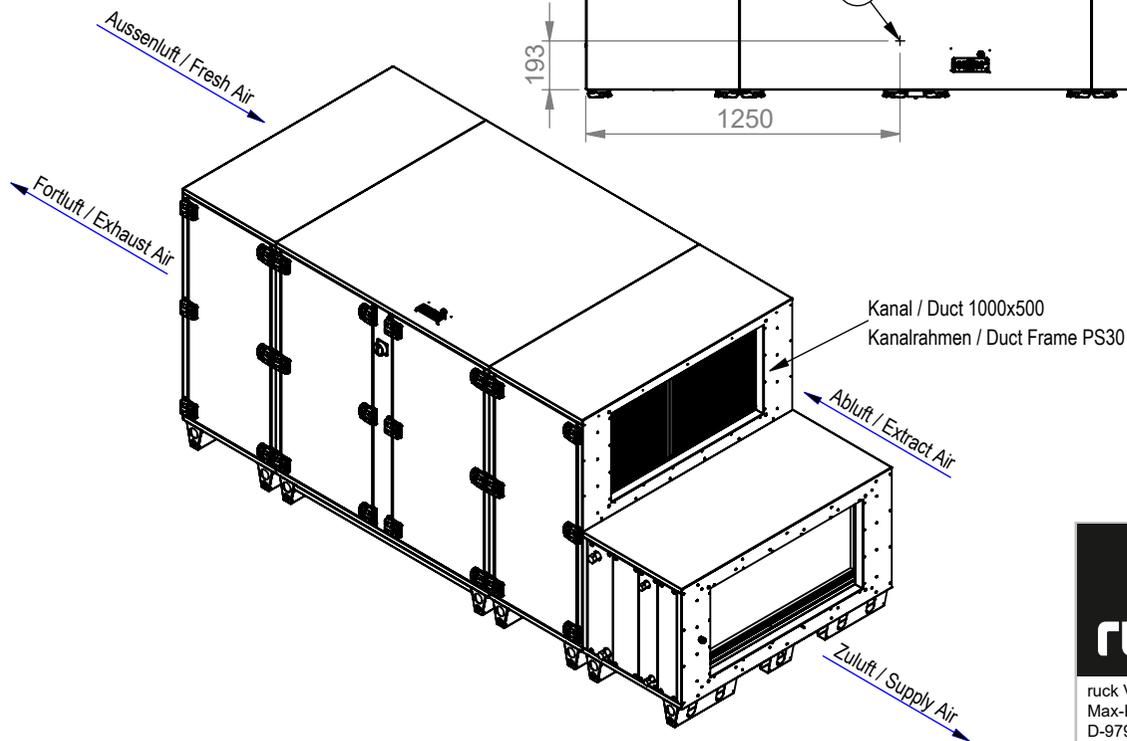

1:30 A4 mm

Protection Mark according to ISO 16016

General tolerances DIN ISO 2768-c

Created d.ursu  
 Drawn d.ursu  
 Released a.ganea  
 Disabled

11.07.2023  
 11.07.2023  
 10.03.2025

**ETAK5000HWKJRT**

**168425 00**

**ruck**  
 ruck Ventilatoren  
 Max-Planck-Str. 5  
 D-97944 Boxberg