

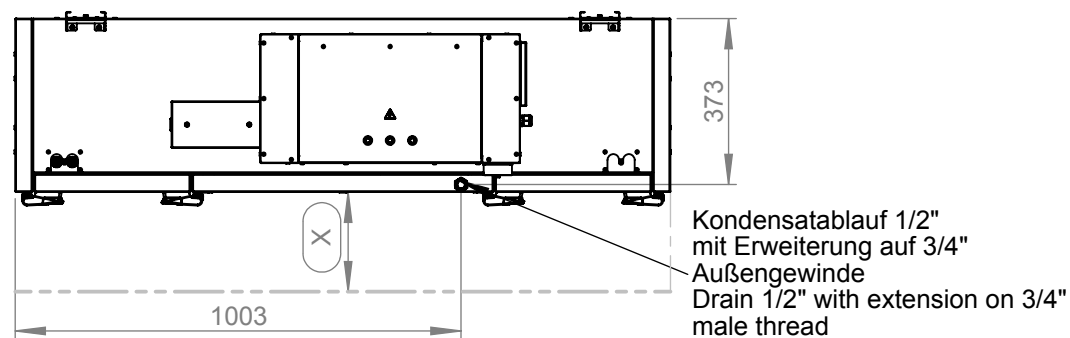
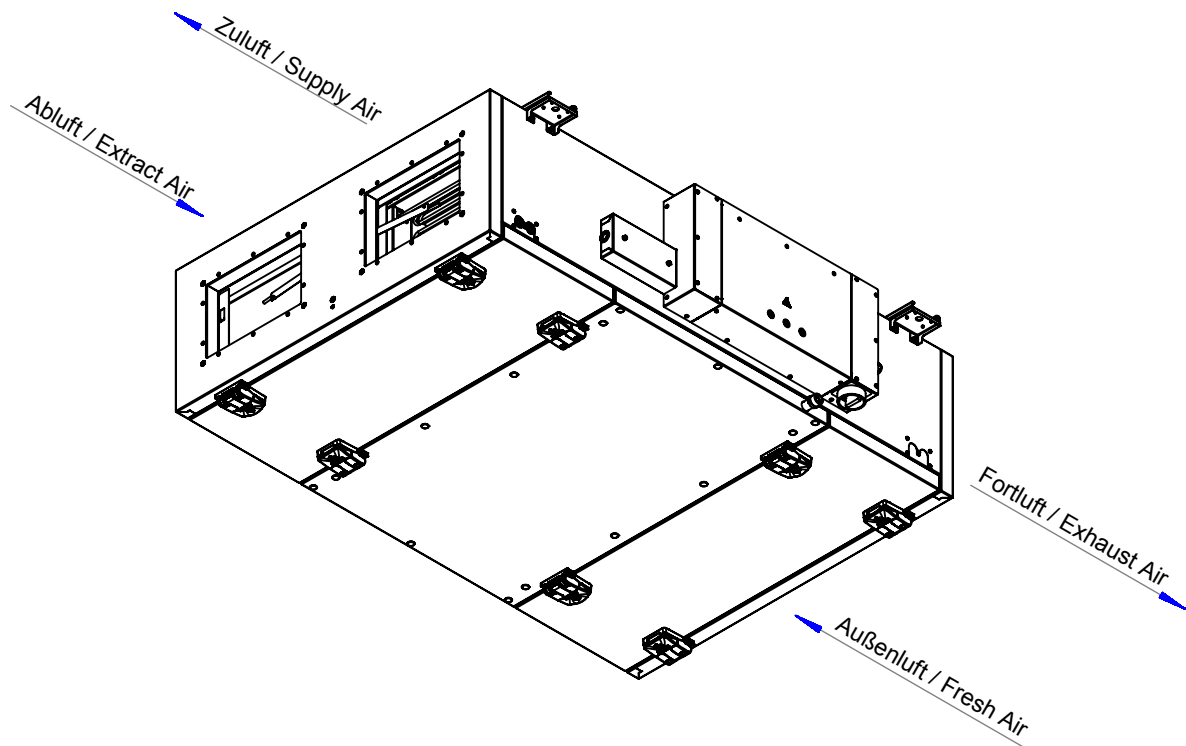


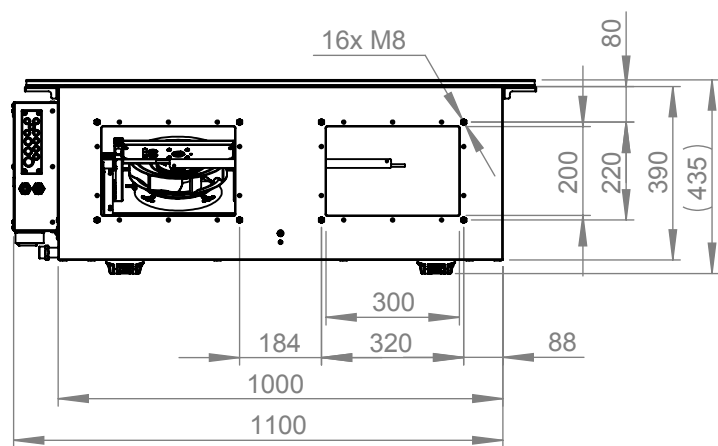

X	Tür abnehmen/ remove door	min. 170mm
X	Tür aufklappen/ open the door	min. 450mm
X	Filter entnehmen/ remove filters	min. 320mm
Y	elektrischer Anschluss/ electrical connection	min. 100mm empf./ rec. 300mm
Z	Anschlusskabel/ cable connection	min. 200mm

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

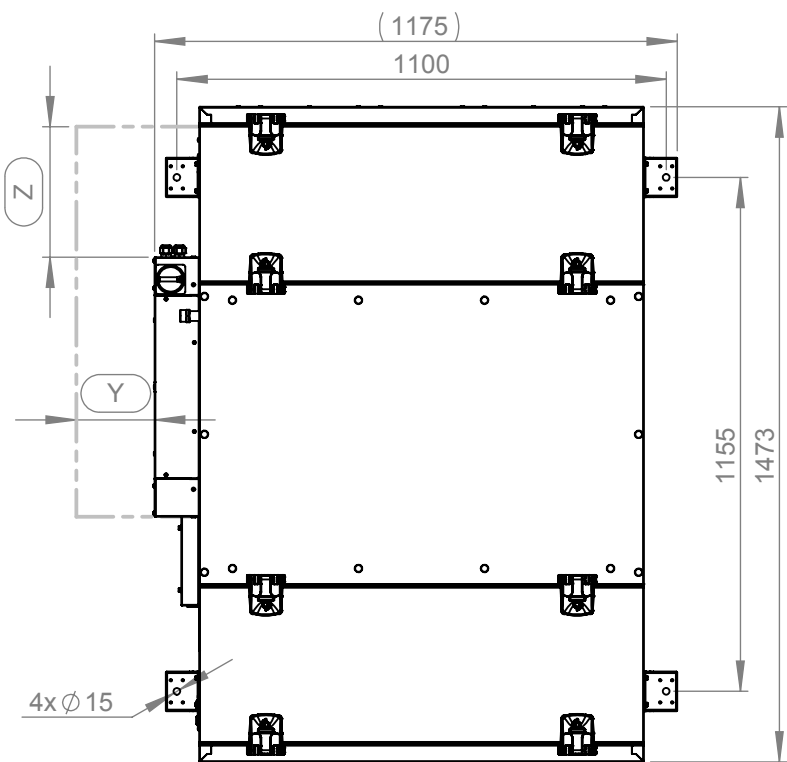

Protection Mark
according to ISO16016

Created ma.fessler
Drawn ma.fessler
Released ma.fessler
Disabled

1:17 A4 mm

General tolerances
DIN ISO 2768-c

08.06.2022
08.06.2022
04.07.2024

ETAK700FEOJL

163708 00