

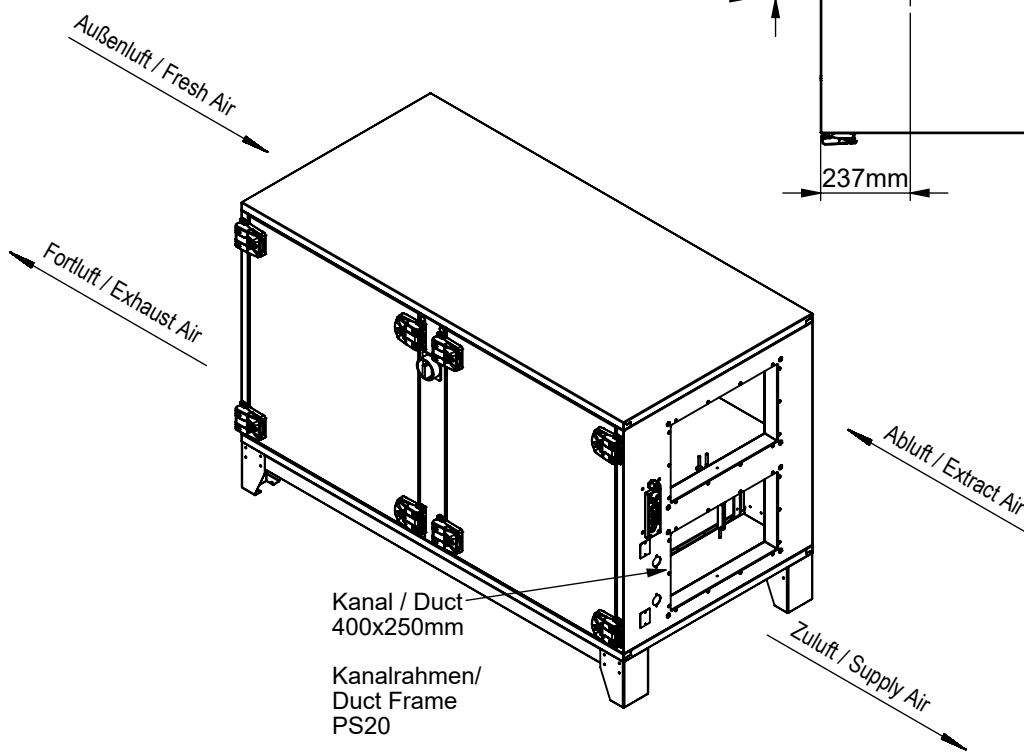
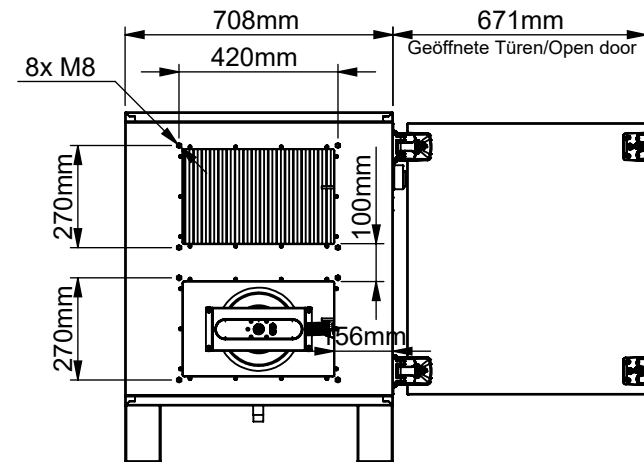
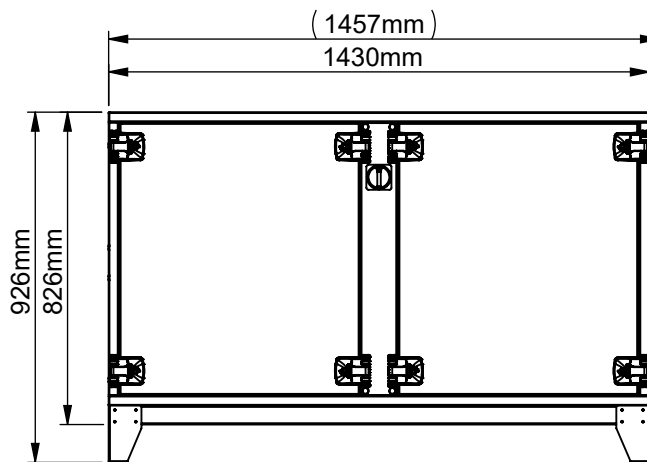


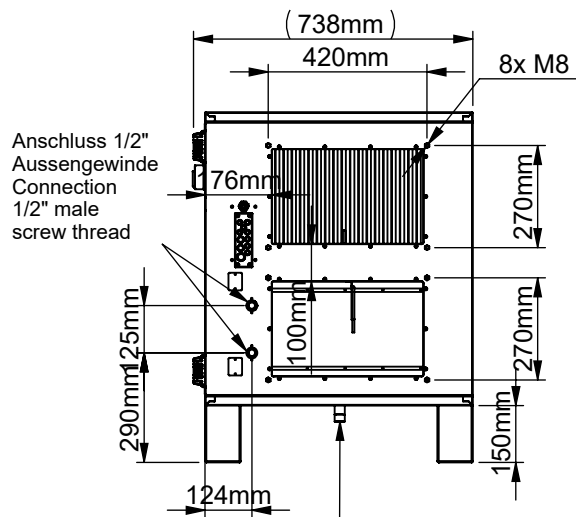

ruck
VENTILATOREN
ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO16016

Created d.ursu
Drawn d.ursu
Released
Disabled

1:20 A4 mm

General tolerances
DIN ISO 2768-c

20.10.2022
20.10.2022

ETAK700HWOJR

165409 00