
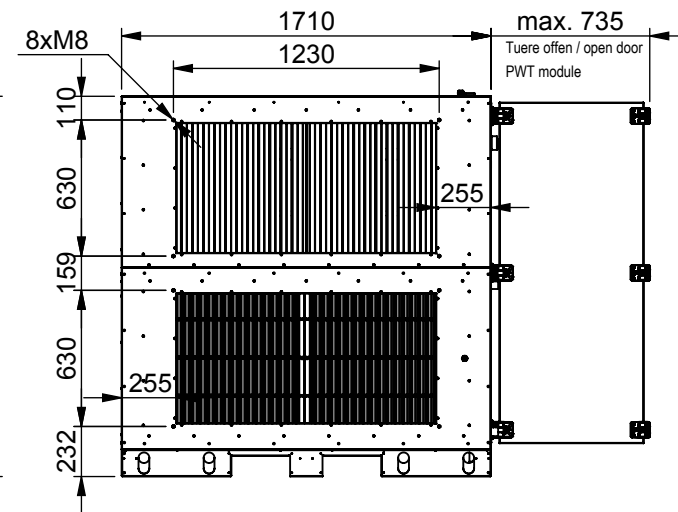
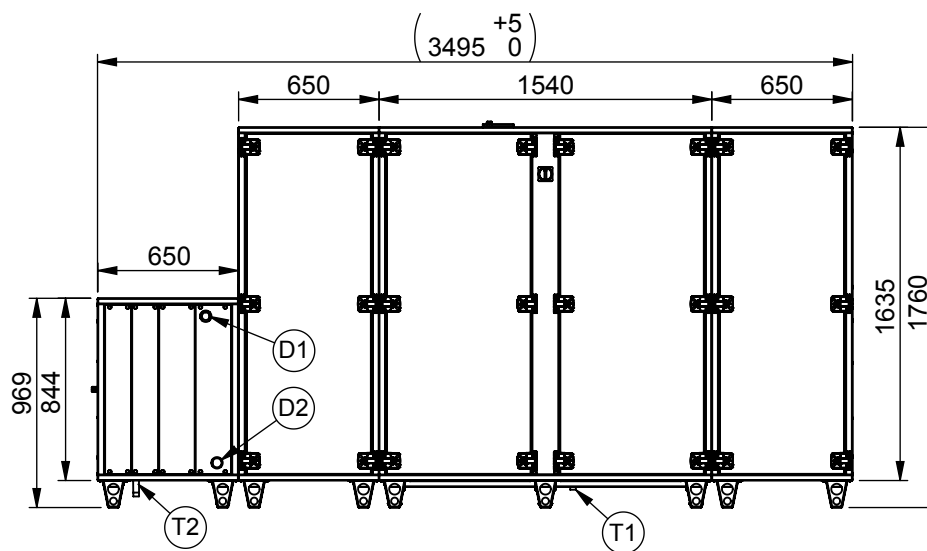
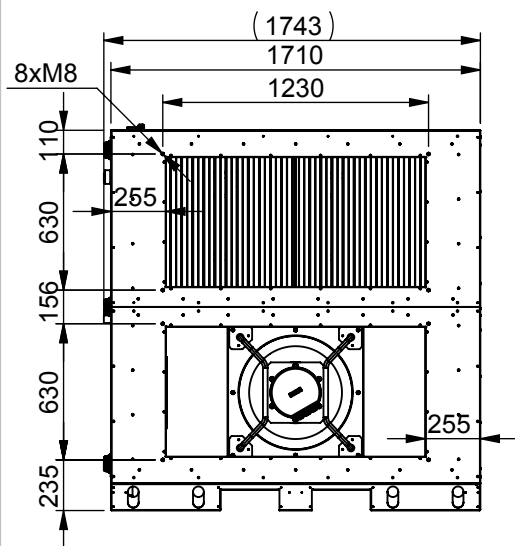



- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (T2) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (D1) Kältemiteleinlass $\varnothing 35$ / Refrigerant Inlet $\varnothing 35$
- (D2) Kältemittelauslass $\varnothing 42$ / Refrigerant Outlet $\varnothing 42$

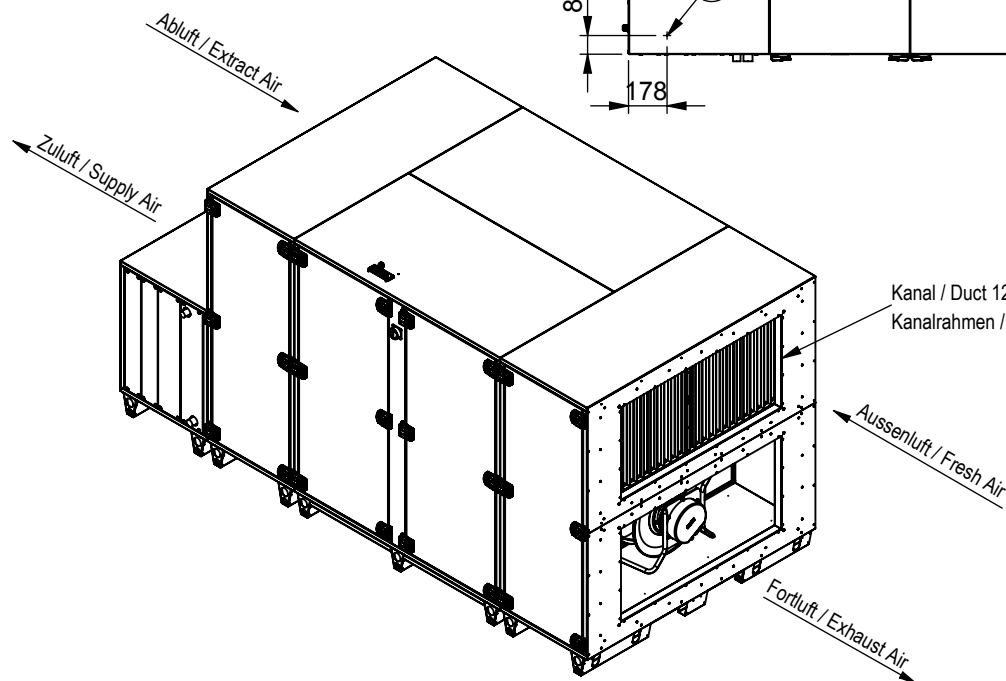

Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created d.ursu
Drawn d.ursu
Released d.ursu
Disabled

21.08.2023
21.08.2023
21.08.2023

ETAK7600HODJLT

168912 00