

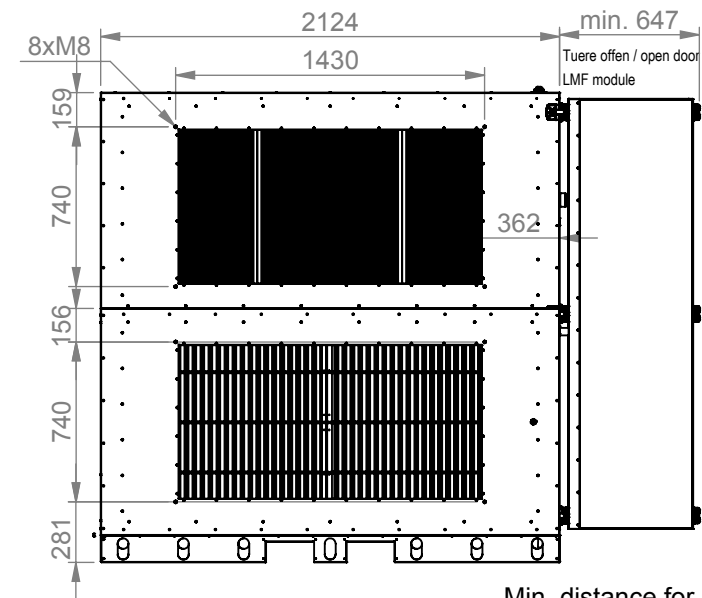
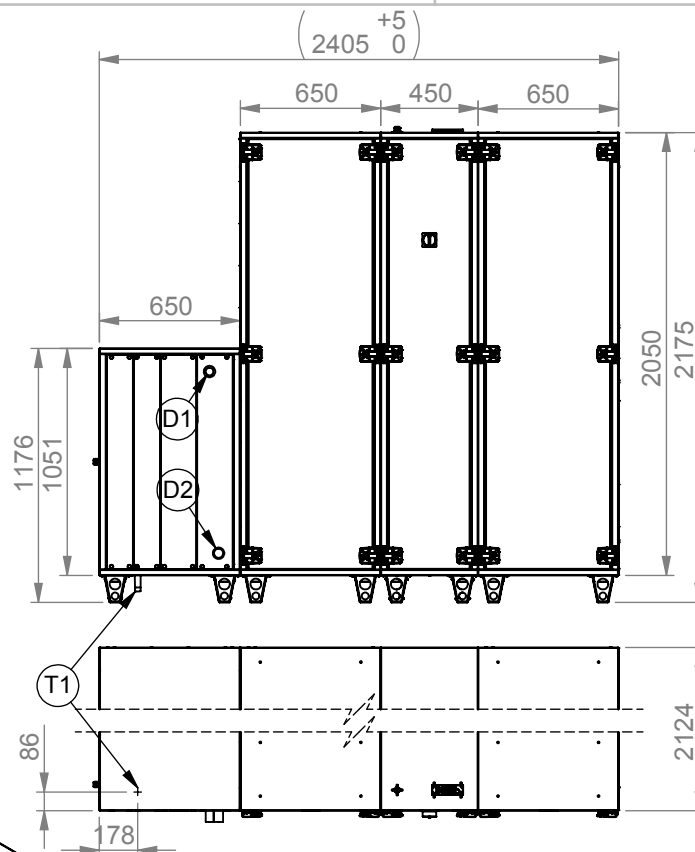


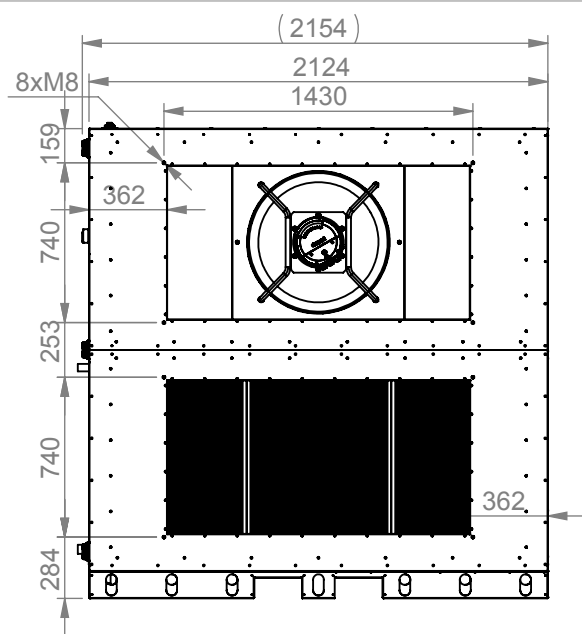

Min. distance for changing the filter 680mm !!!

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (D1) Kältemiteleinlass $\varnothing$ 35 / Refrigerant Inlet $\varnothing$ 35
- (D2) Kältemittelauslass $\varnothing$ 42 / Refrigerant Outlet $\varnothing$ 42

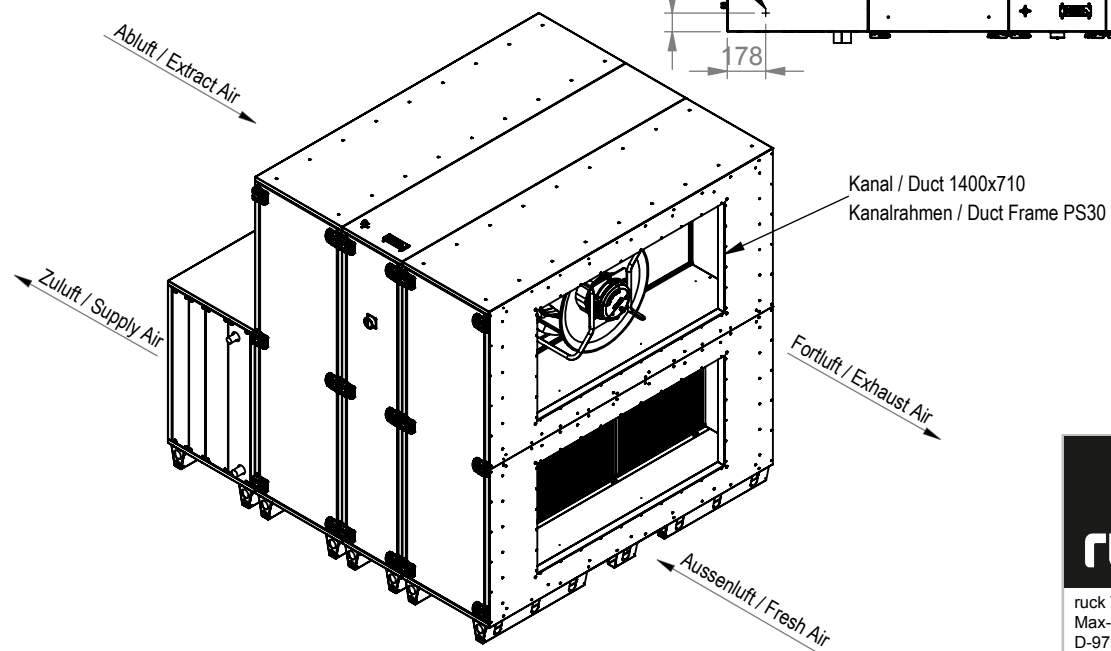

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO 16016

Created I.benk
Drawn I.benk
Released I.benk
Disabled

1:35 A4 mm

General tolerances
DIN ISO 2768-c

14.03.2024
14.03.2024
20.03.2024

ROK12600HODJLT

171445 00