

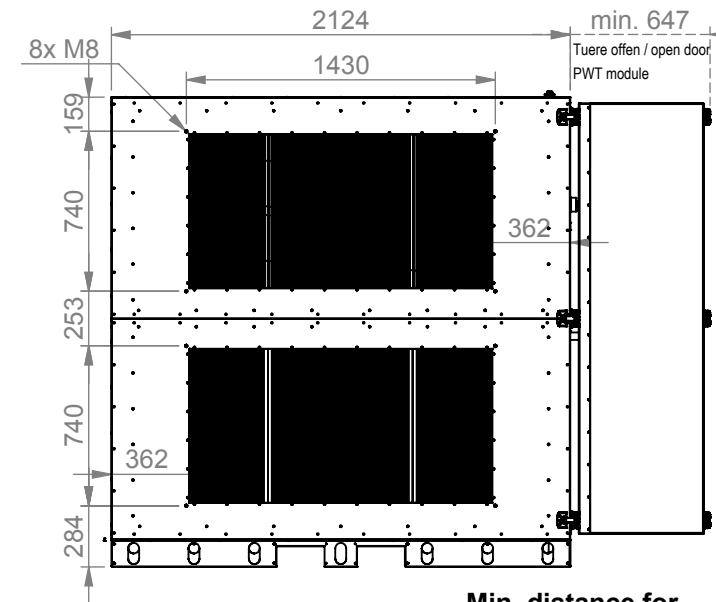
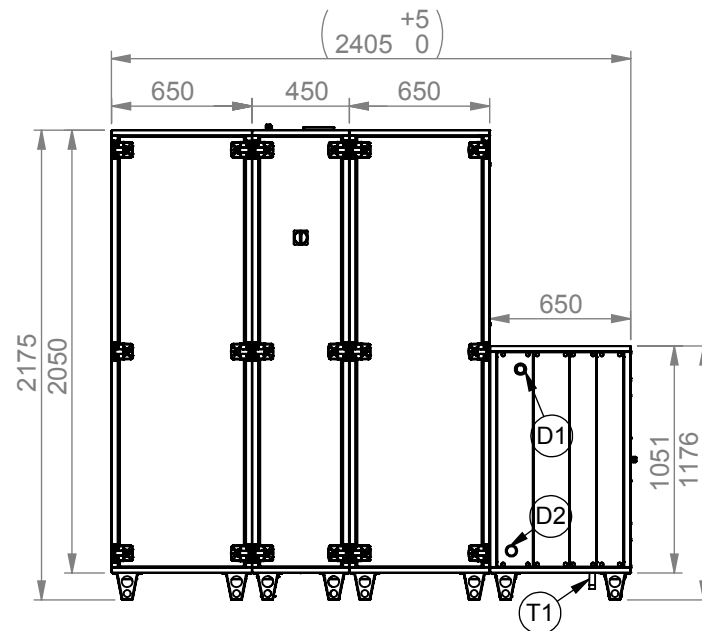
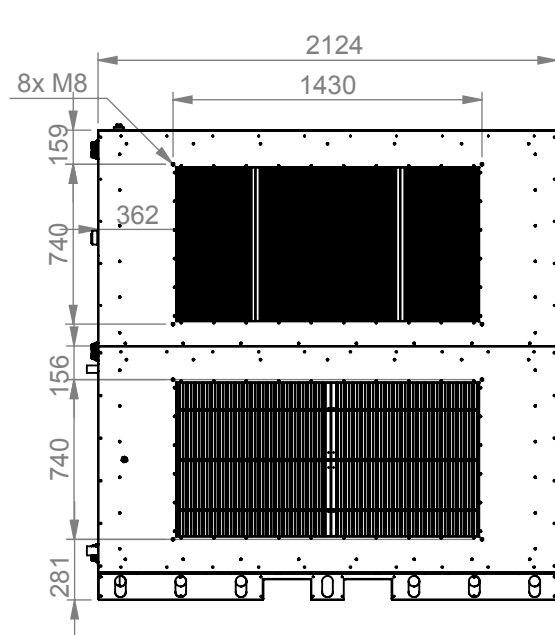


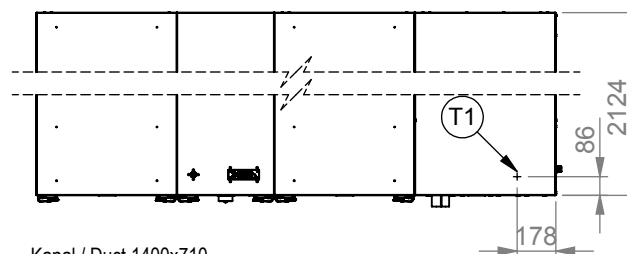

**Min. distance for
changing the
filter 680mm !!!**

- (T1)** Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (D1)** Kältemiteleinlass $\varnothing$ 35 / Refrigerant Inlet $\varnothing$ 35
- (D2)** Kältemittelauslass $\varnothing$ 42 / Refrigerant Outlet $\varnothing$ 42

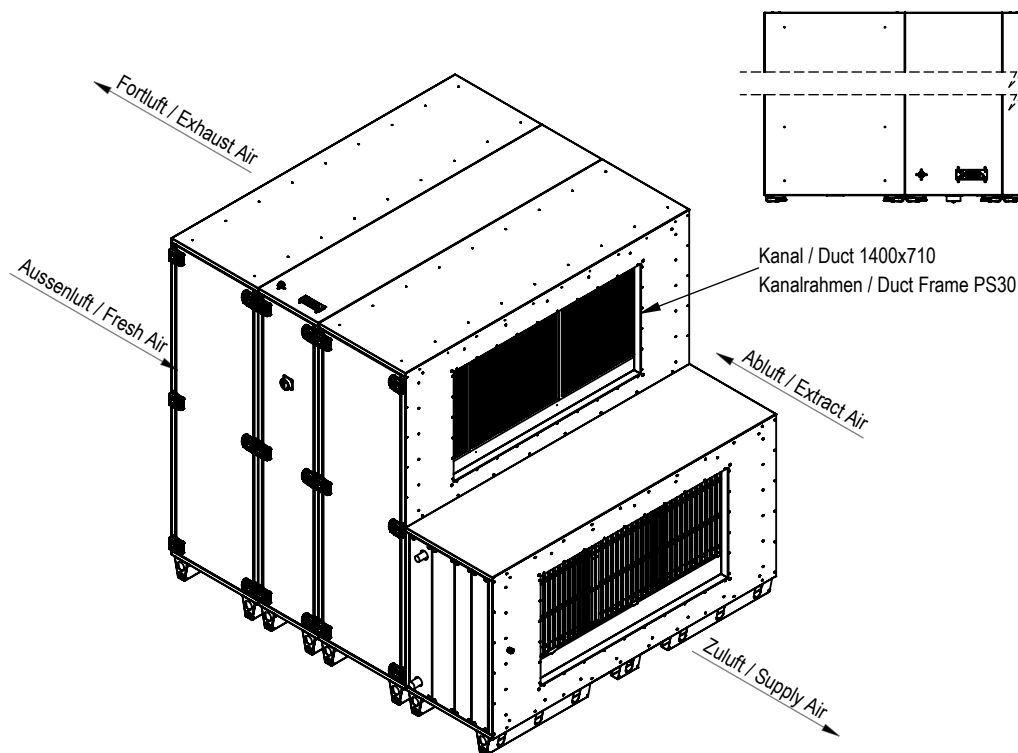

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO16016

Created I.benk
Drawn I.benk
Released I.benk
Disabled

1:35 A4 mm

General tolerances
DIN ISO 2768-c

13.03.2024
13.03.2024
19.03.2024

ROK12600HODJRT

171440 00