
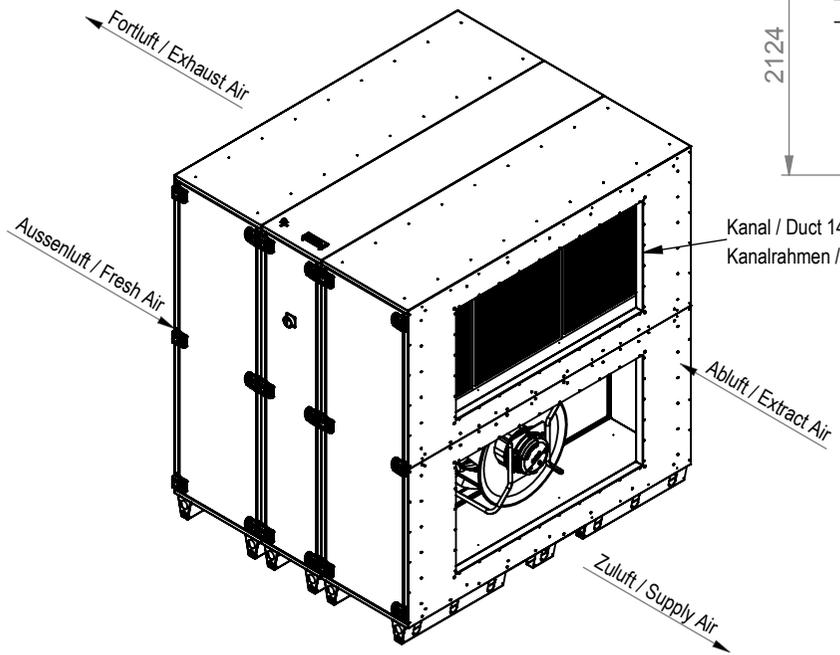


Min. distance for changing the filter 680mm !!!

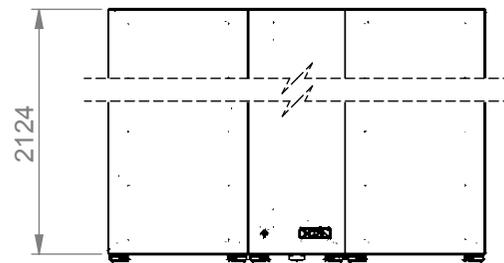

ruck
 ruck Ventilatoren
 Max-Planck-Str. 5
 D-97944 Boxberg

Protection Mark according to ISO16016
 Created I.benk
 Drawn I.benk
 Released Disabled
 1:35 A4 mm
 General tolerances DIN ISO 2768-c
 13.03.2024
 13.03.2024

ROK12600HOOJRT
171437 00