


Min. distance for changing the filter 680mm !!!



- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 1" Aussengewinde / Connection 1" male tread
- (D1) Kältemittelleinlass $\varnothing 35$ / Refrigerant Inlet $\varnothing 35$
- (D2) Kältemittelauslass $\varnothing 42$ / Refrigerant Outlet $\varnothing 42$

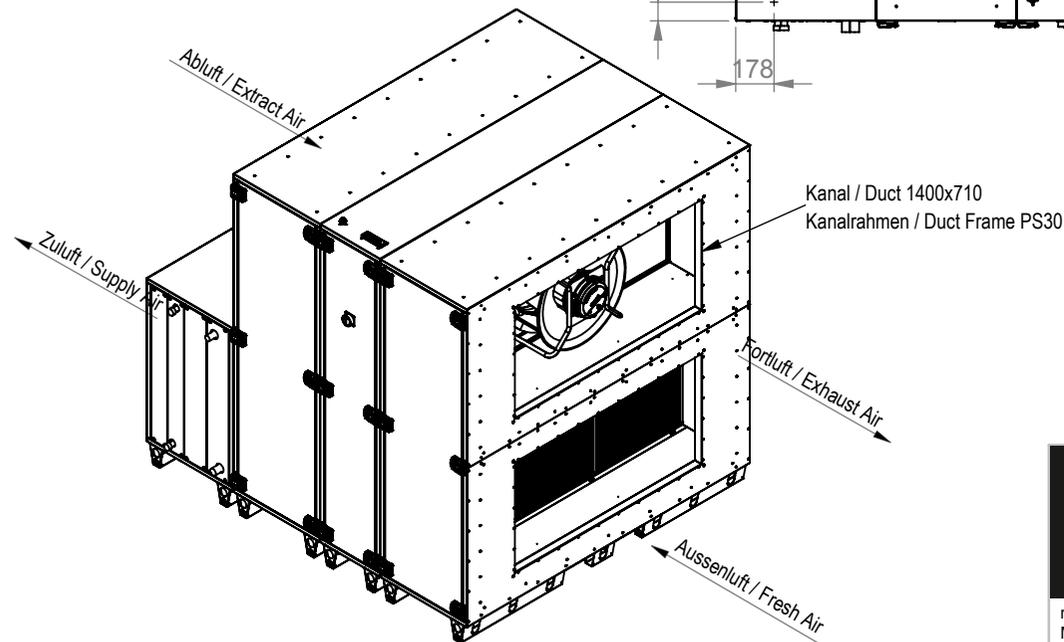

1:35 A4 mm

Protection Mark according to ISO 16016

General tolerances DIN ISO 2768-c

Created I.benk
 Drawn I.benk
 Released I.benk
 Disabled

14.03.2024
 14.03.2024
 20.03.2024

ROK12600HWDJLT

171444 00

ruck

ruck Ventilatoren
 Max-Planck-Str. 5
 D-97944 Boxberg