



Min. distance for changing the filter 680mm !!!

⊙ Anschluss 1" Aussengewinde / Connection 1" male tread

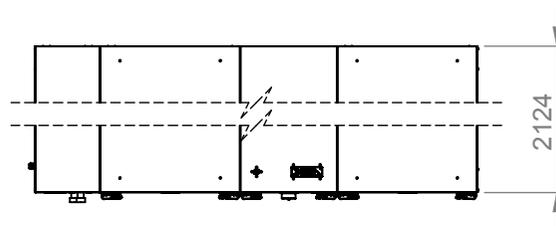

Kanal / Duct 1400x710  
Kanalrahmen / Duct Frame PS30

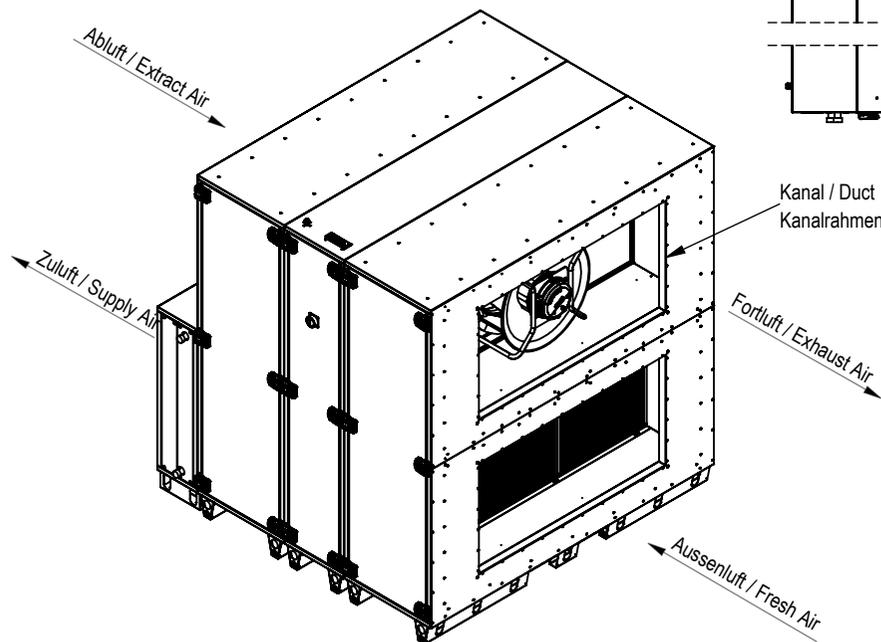

Protection Mark according to ISO16016

Created I.benk  
Drawn I.benk  
Released I.benk  
Disabled

1:35 A4 mm

General tolerances DIN ISO 2768-c

14.03.2024  
14.03.2024  
20.03.2024

**ROK12600HWOJLT**

**171443 00**

**ruck**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg