

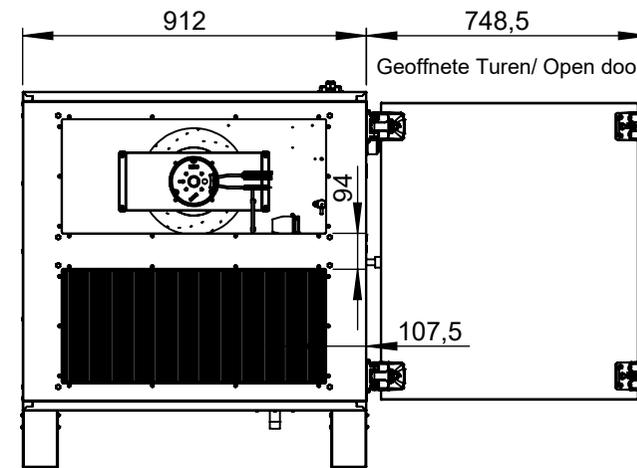
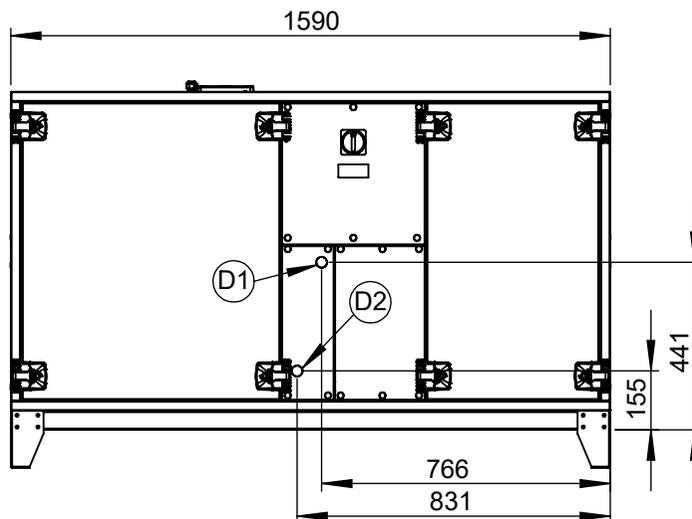


Kondensatablauf 3/4"
Außengewinde
Drain 3/4"
male thread

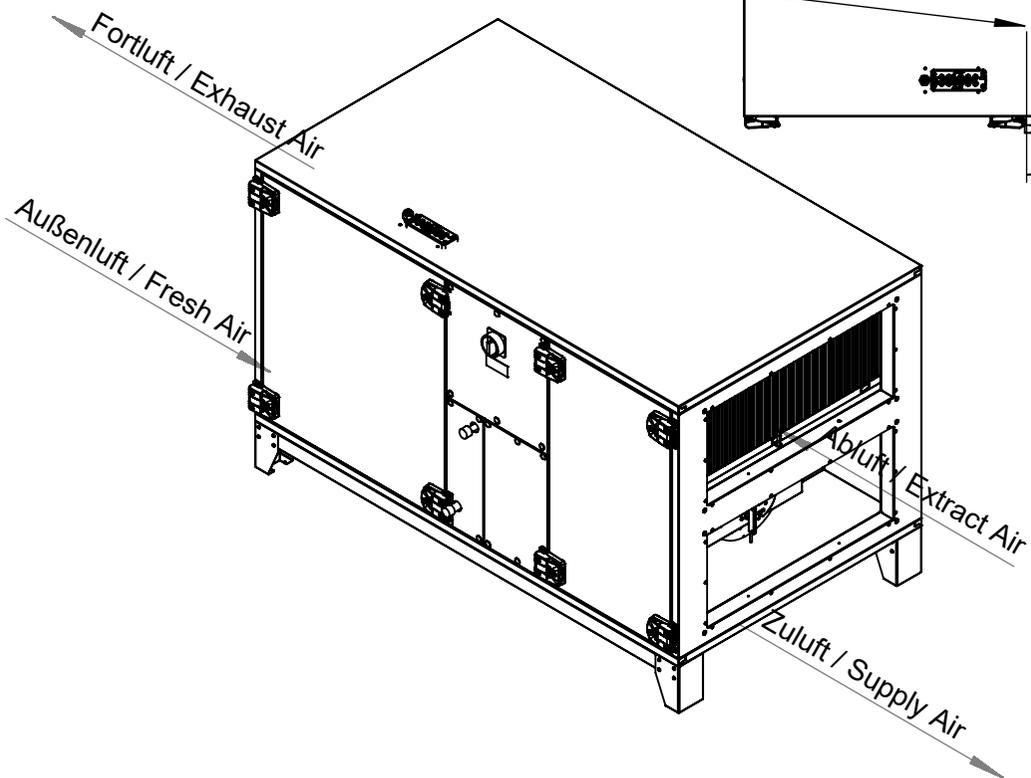

- Ⓧ D1 Kältemittelinlass 12 / Refrigerant Inlet 12
- Ⓧ D2 Kältemittelinlass 16 / Refrigerant Outlet 16

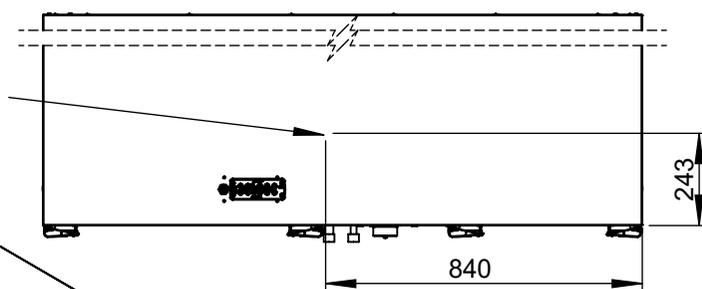

1:20 A4 mm

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Protection Mark
according to ISO16016

Created I.benk
Drawn I.benk
Released I.benk
Disabled

General tolerances
DIN ISO 2768-c

19.05.2025
19.05.2025
26.06.2025

ROTK1500HODJR

175739 00