

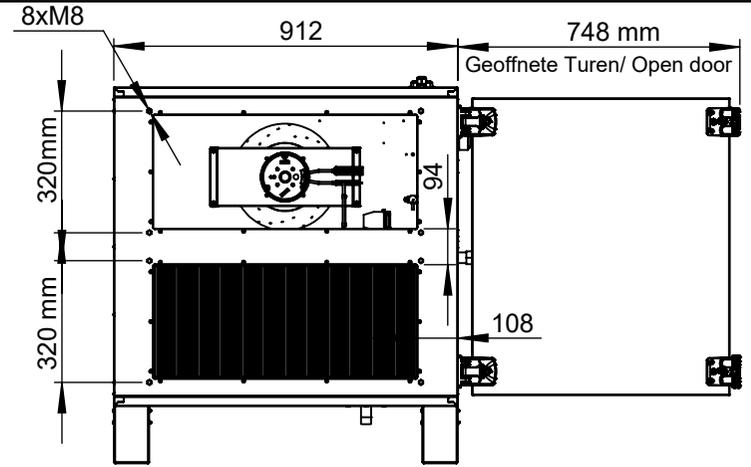
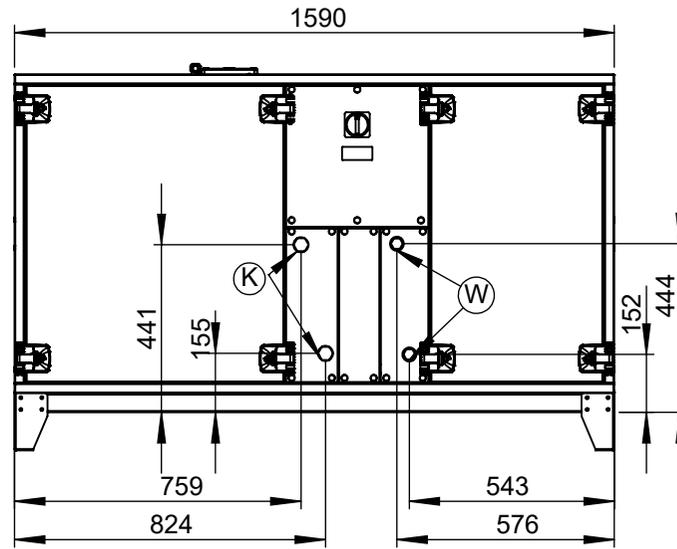



Kondensatablauf 3/4"  
Außengewinde  
Drain 3/4"  
male thread

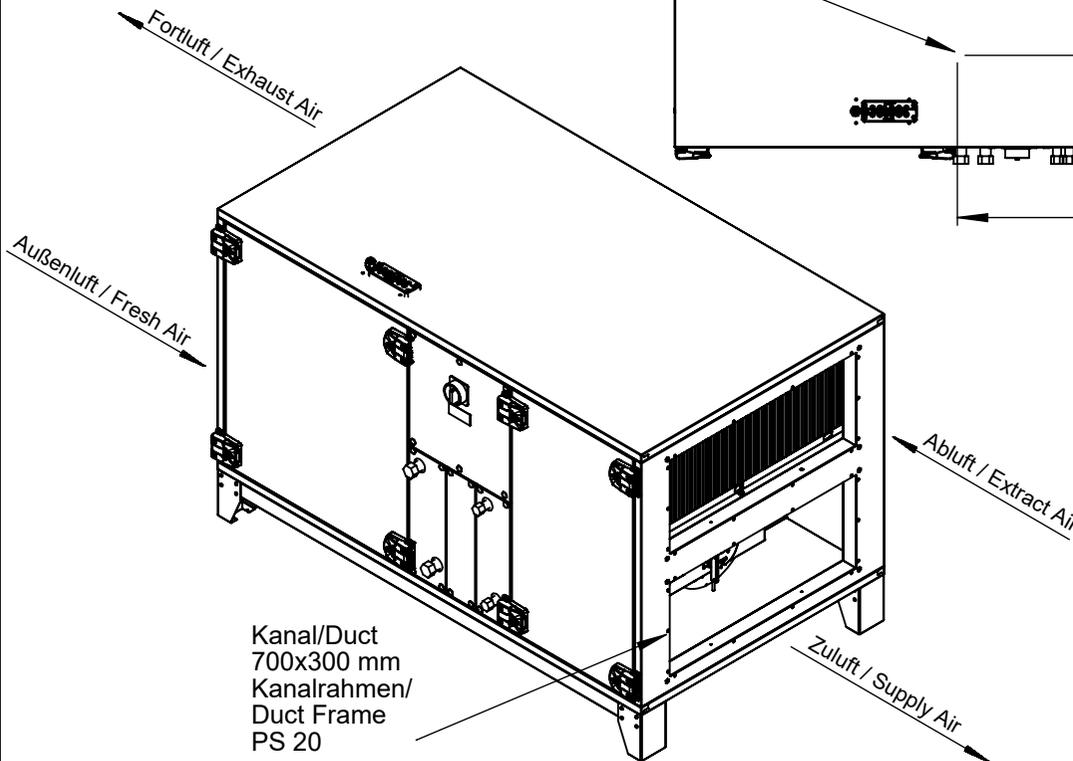

(W) Anschluss 3/4" Aussengewinde / Connection 3/4" male thread

(K) Anschluss 1" Aussengewinde / Connection 1" male thread

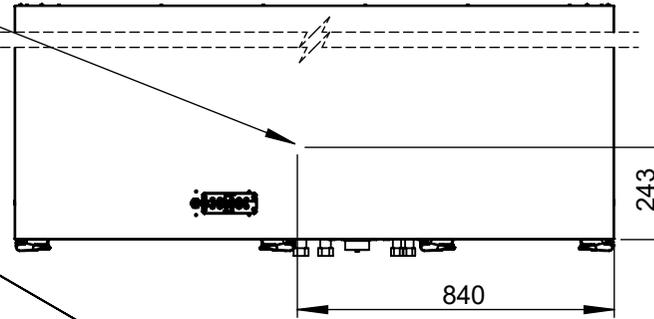

Protection Mark  
according to ISO 16016

1:20 A4 mm

General tolerances  
DIN ISO 2768-c

**ruck**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg

Created I.benk  
Drawn I.benk  
Released I.benk  
Disabled

19.05.2025  
19.05.2025  
02.07.2025

**ROK1500HWKJR**

**175737 00**