



Min. distance for changing the filter 860mm !!!

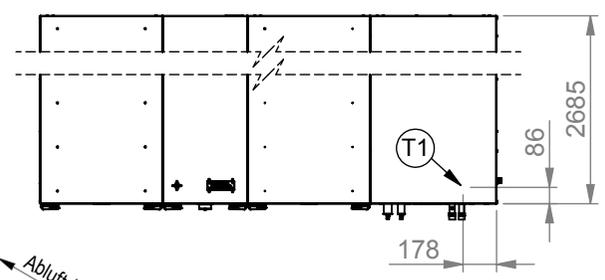

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 1 1/4" Aussengewinde / Connection 1 1/4" male tread
- (D1) Kältemittelinlass Ø 35 / Refrigerant Inlet Ø 35
- (D2) Kältemittelinlass Ø 42 / Refrigerant Inlet Ø 42

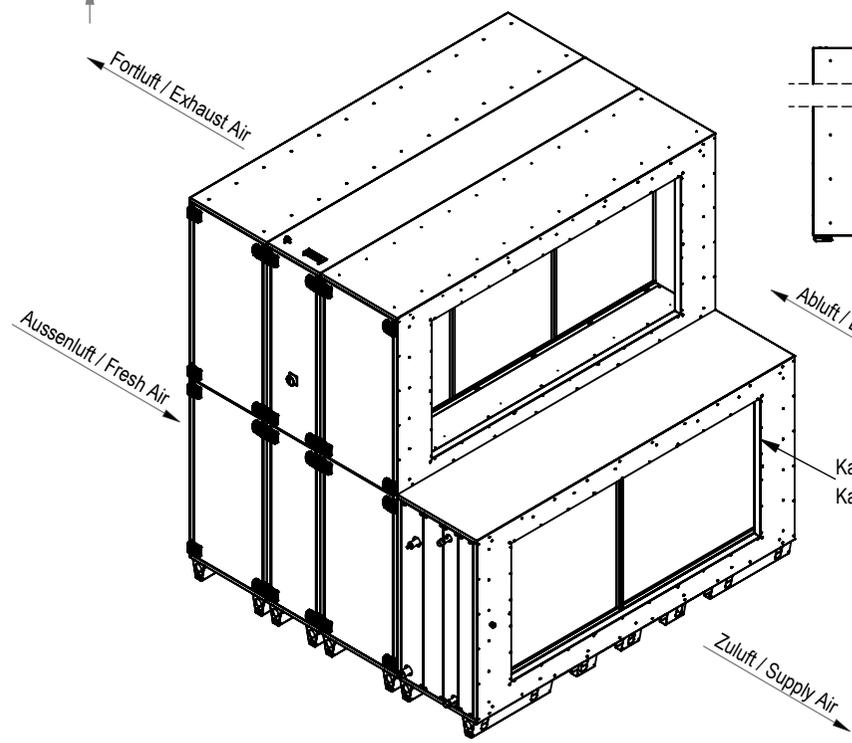

Protection Mark according to ISO16016
 Created d.ursu
 Drawn d.ursu
 Released
 Disabled

General tolerances DIN ISO 2768-c
 13.05.2024
 13.05.2024

ROTK2000HWDJRT

172244 00

1:40 A4 mm