



Min. distance for changing the filter 860mm !!!

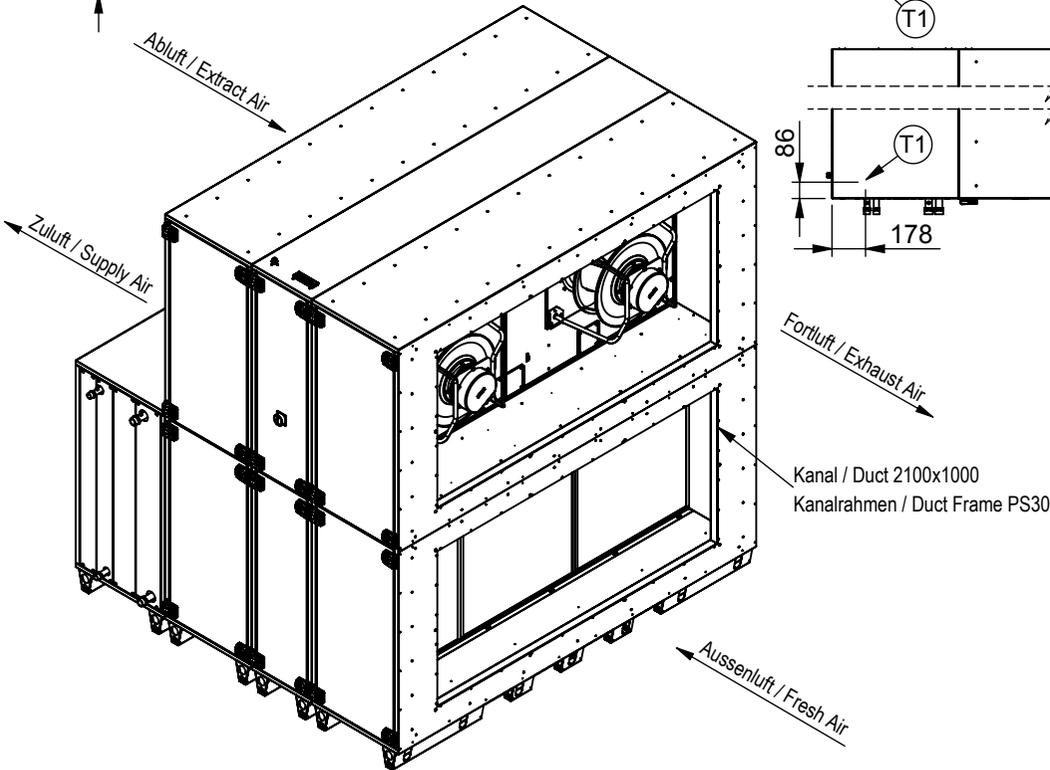

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 1"1/4 Aussengewinde / Connection 1"1/4 male tread
- (K) Anschluss 1"1/4 Aussengewinde / Connection 1"1/4 male tread



Protection Mark according to ISO16016

1:40 A4 mm

General tolerances DIN ISO 2768-c

ROTK20000HWKJLT

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created d.ursu
Drawn d.ursu
Released d.ursu
Disabled

23.05.2024
23.05.2024
23.05.2024

172436 00