
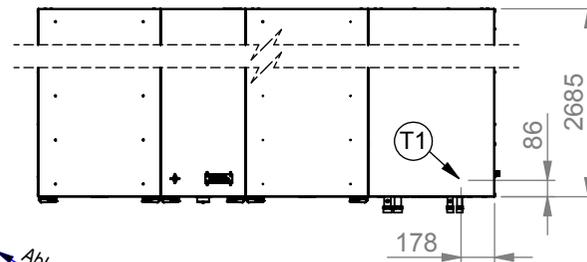


Min. distance for changing the filter 860mm !!!

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 1"1/4 Aussengewinde / Connection 1"1/4 male tread
- (K) Anschluss 1"1/4 Aussengewinde / Connection 1"1/4 male tread

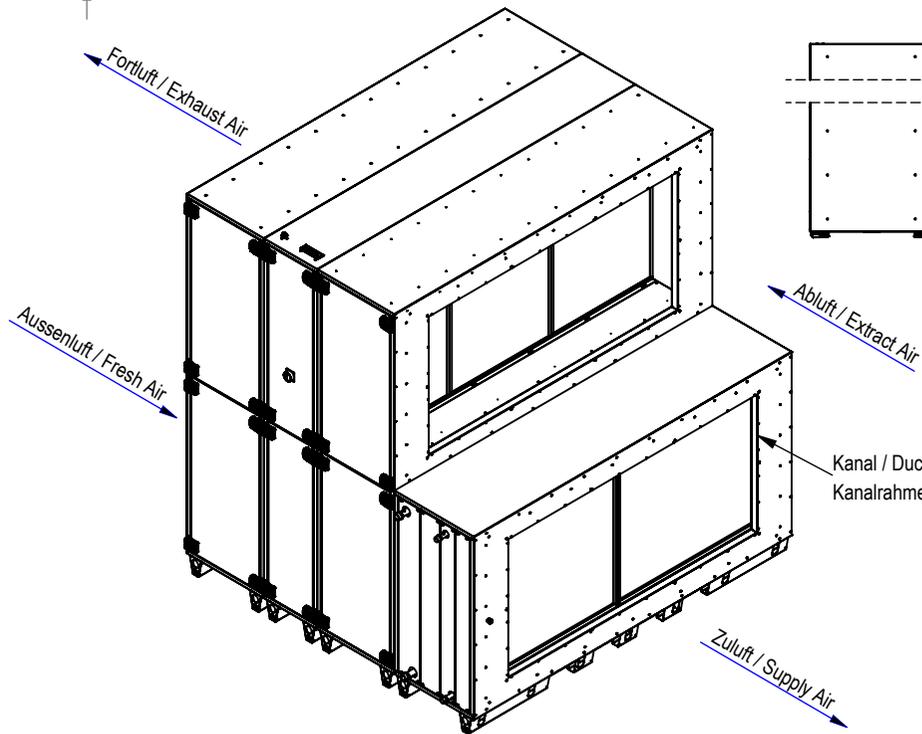

Protection Mark according to ISO 16016

Created d.ursu
Drawn d.ursu
Released
Disabled

1:40 A4 mm

General tolerances
DIN ISO 2768-c

13.05.2024
13.05.2024

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

ROTK2000HWKJRT

172249 00