



Kondensatablauf 3/4" Außengewinde  
Drain 3/4" male thread

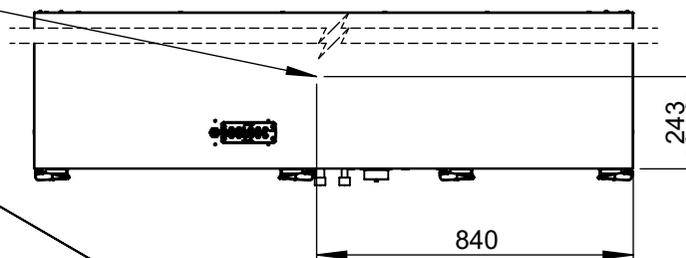

- (D1) Kältemitteleinlass 12 / Refrigerant Inlet 12
- (D2) Kältemitteleinlass 16 / Refrigerant Outlet 16

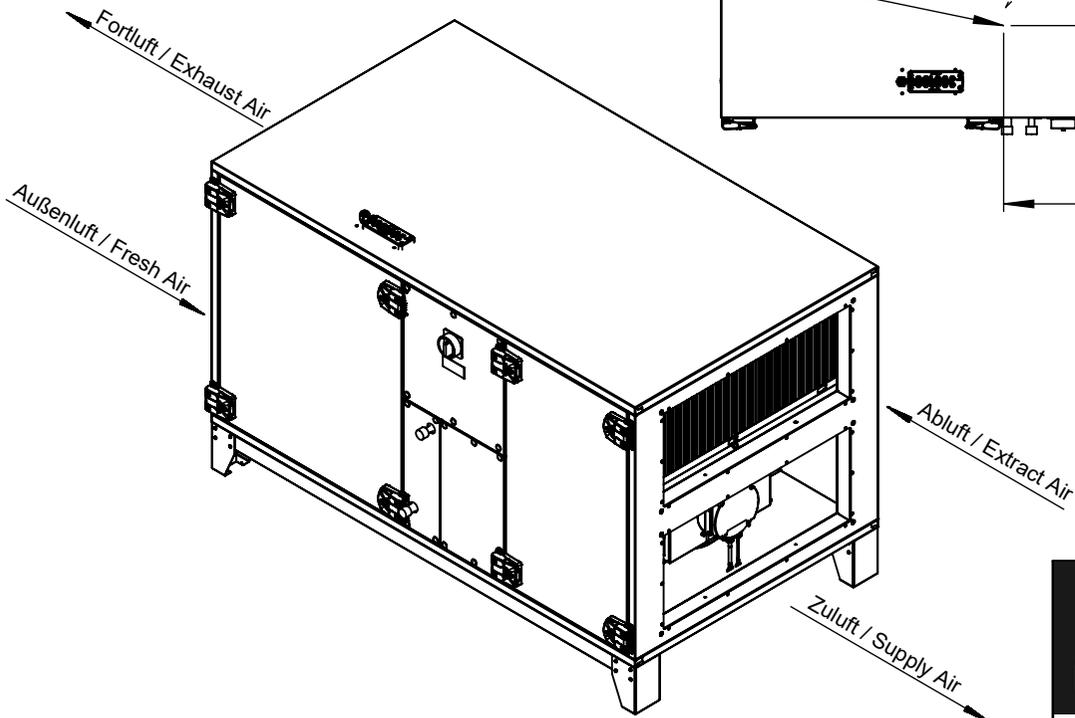

1:20 A4 mm

Protection Mark  
according to ISO16016

General tolerances  
DIN ISO 2768-c

**ROTK2000HODJR**

Created I.benk  
Drawn I.benk  
Released I.benk  
Disabled

28.02.2025  
28.02.2025  
03.07.2025

**174890 00**

**ruck**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg