

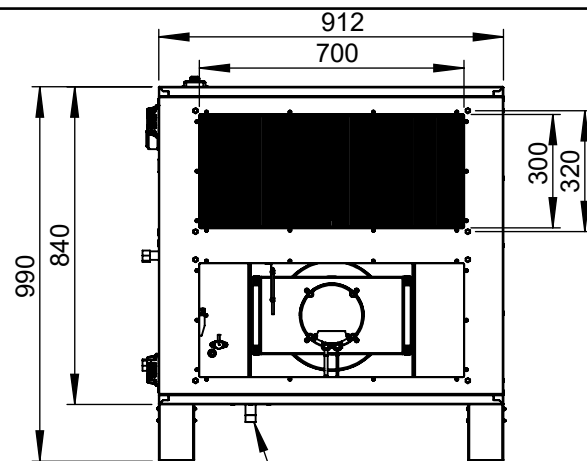


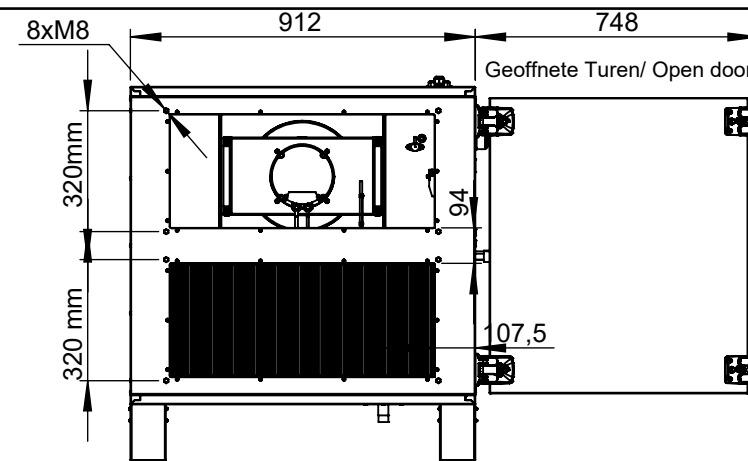

Kondensatablauf 3/4"
Außengewinde
Drain 3/4"
male thread


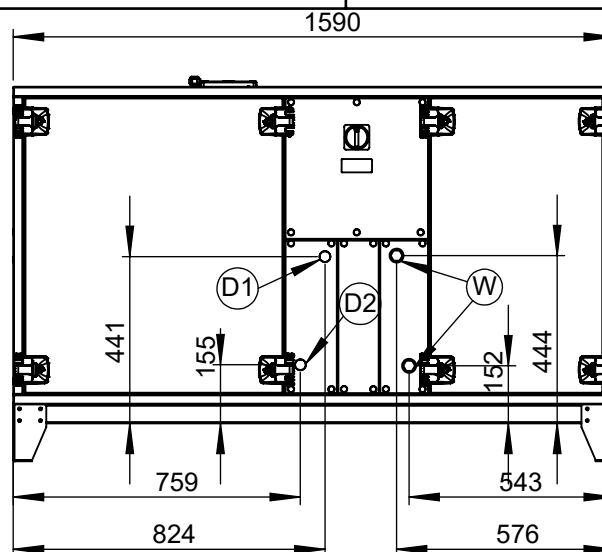


Geöffnete Türen/ Open door

(W) Anschluss 3/4" Außengewinde/ Connection 3/4" male thread

(D1) Kältemiteleinlass 12 / Refrigerant Inlet 12

(D2) Kältemiteleinlass 16 / Refrigerant Outlet 16

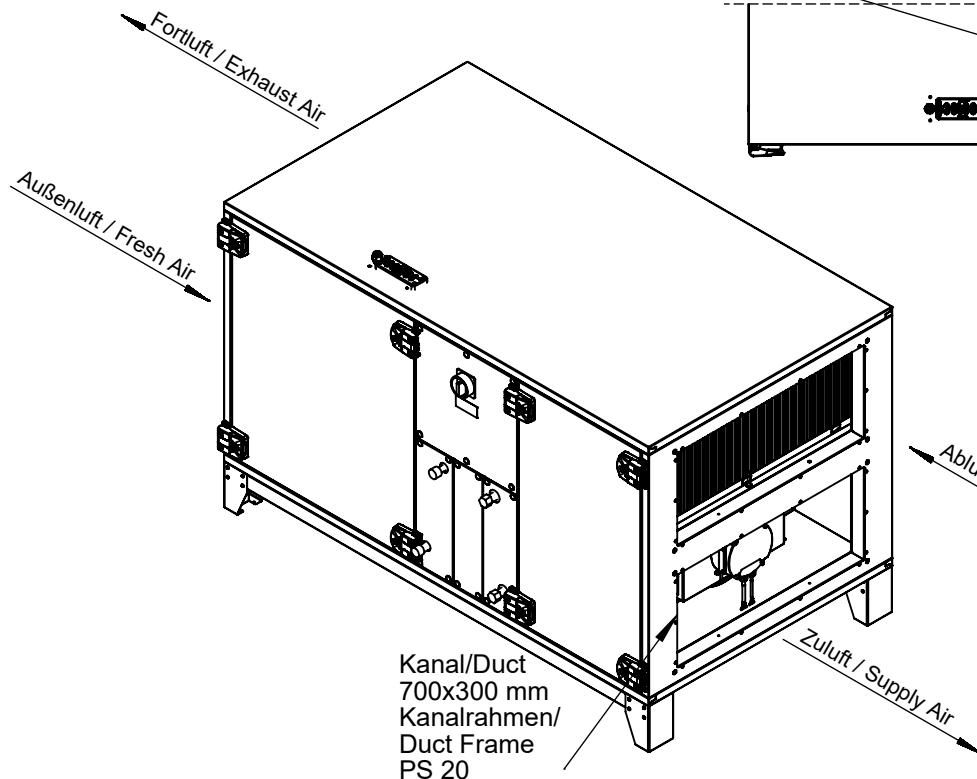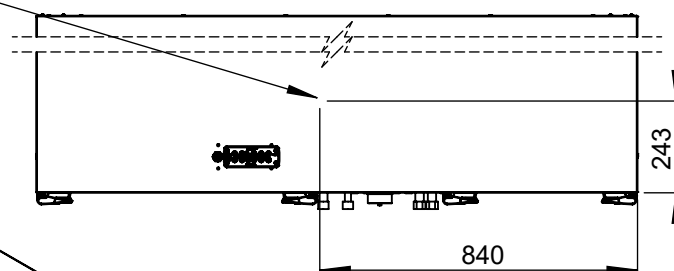

Kanal/Duct
700x300 mm
Kanalrahmen/
Duct Frame
PS 20

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO 16016

Created I.benk
Drawn I.benk
Released I.benk
Disabled

1:20 A4 mm

General tolerances
DIN ISO 2768-c

28.02.2025
28.02.2025
03.07.2025

ROTK2000HWDJR

174889 00