

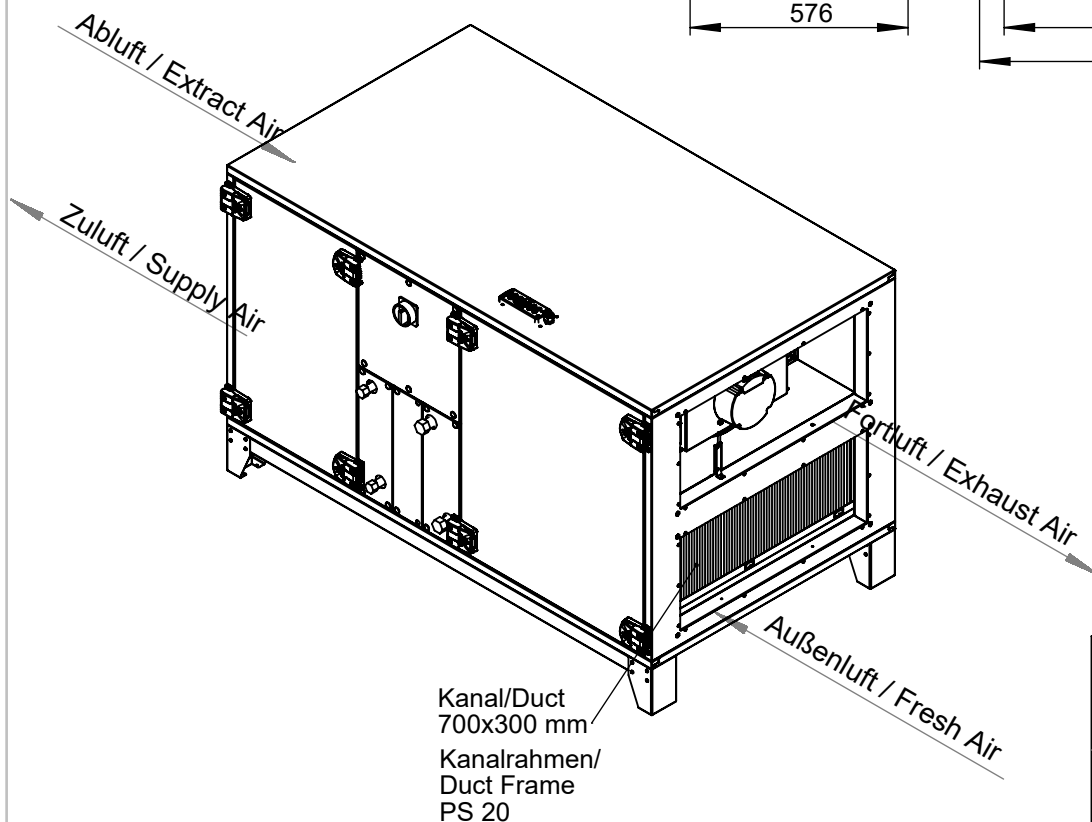
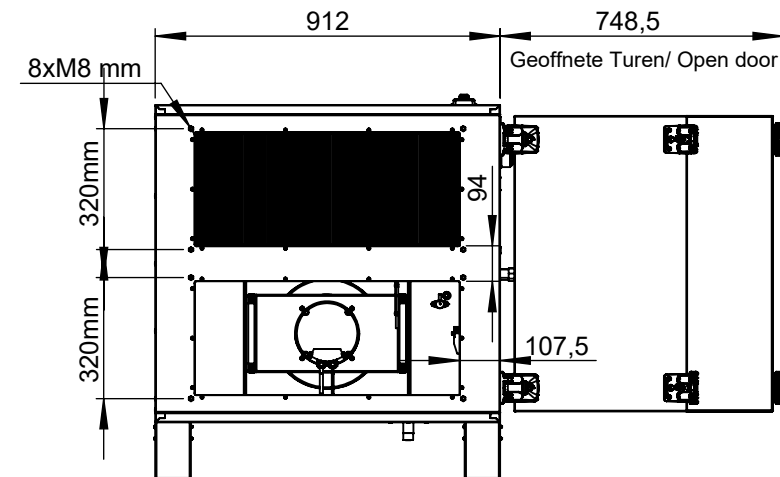
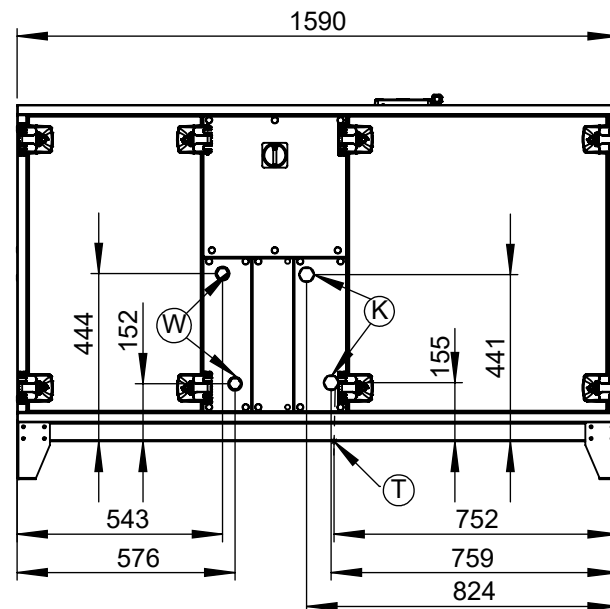


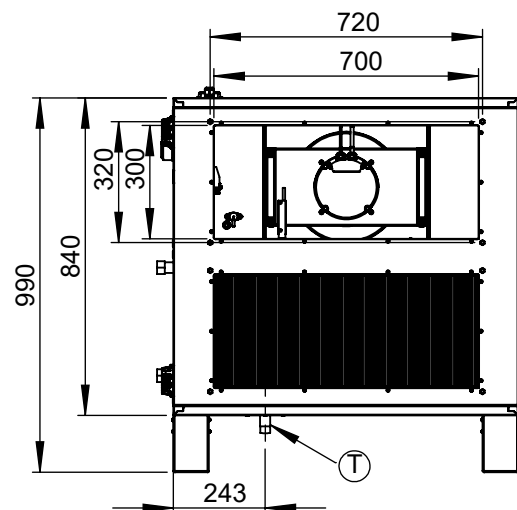

- Ⓜ Anschluss 3/4" Aussengewinde/Connection 3/4"male tread
 Ⓚ Anschluss 1" Aussengewinde / Connection 1" male tread
 Ⓣ Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread



1:20 A4 mm

Protection Mark
according to ISO16016

General tolerances
DIN ISO 2768-c

ROTK2000HWKJL

Created I.benk
 Drawn I.benk
 Released I.benk
 Disabled

12.05.2025
 12.05.2025
 30.06.2025

175673 00

ruck

ruck Ventilatoren
 Max-Planck-Str. 5
 D-97944 Boxberg