
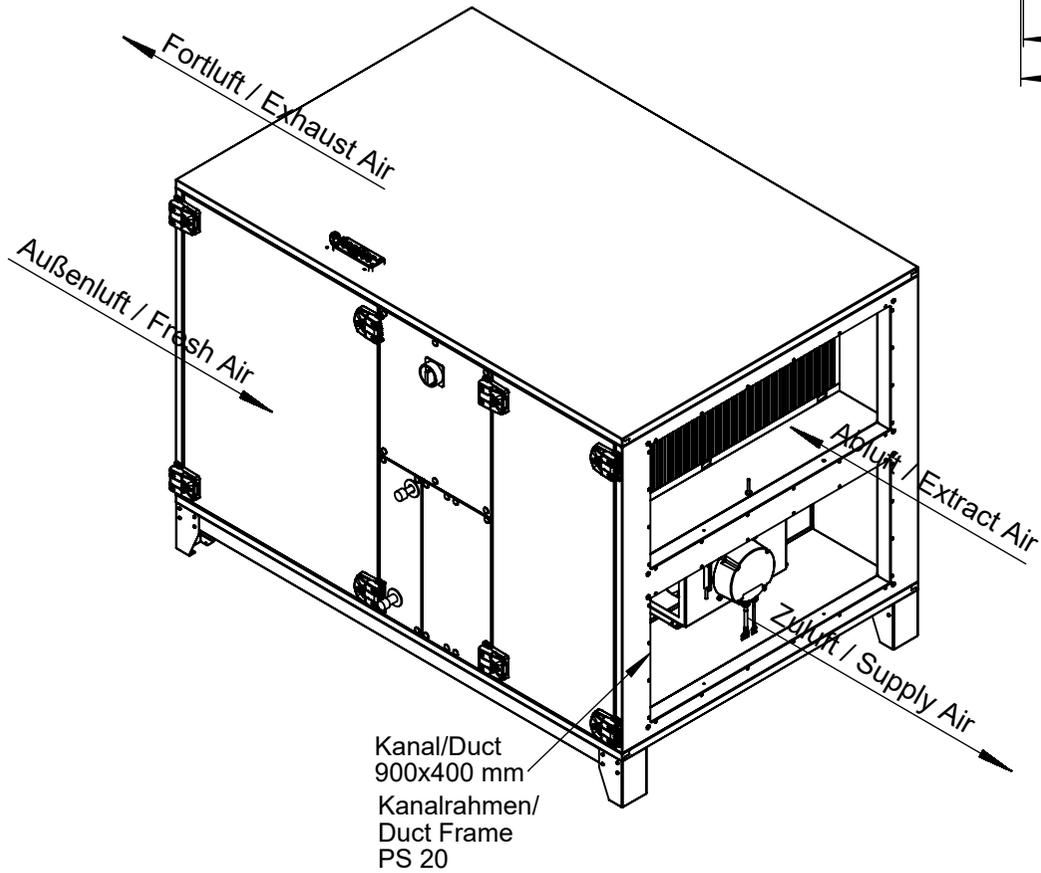


Kondensatablauf  
3/4" Außen-  
gewinde  
Connection  
3/4" Male  
screw thread



- (D1) Kaeltemitteleinlass  $\phi$  12/ Refrigerant Inlet  $\phi$  12
- (D2) Kaeltemitteleinlass  $\phi$  16/ Refrigerant Outlet  $\phi$  16

 <p><b>ruck</b><sup>eu</sup> VENTILATOREN ruck Ventilatoren Max-Planck-Str. 5 D-97944 Boxberg</p>	 <p>Protection Mark according to ISO16016</p>	<p>1:20 A4 mm</p> <p>General tolerances DIN ISO 2768-c</p>	<p><b>ROTK3400HODJR</b></p> <p><b>175343 00</b></p>
	<p>Created I.benk 03.04.2025 Drawn I.benk 03.04.2025 Released I.benk 30.06.2025 Disabled</p>	<p>Created I.benk 03.04.2025 Drawn I.benk 03.04.2025 Released I.benk 30.06.2025 Disabled</p>	