
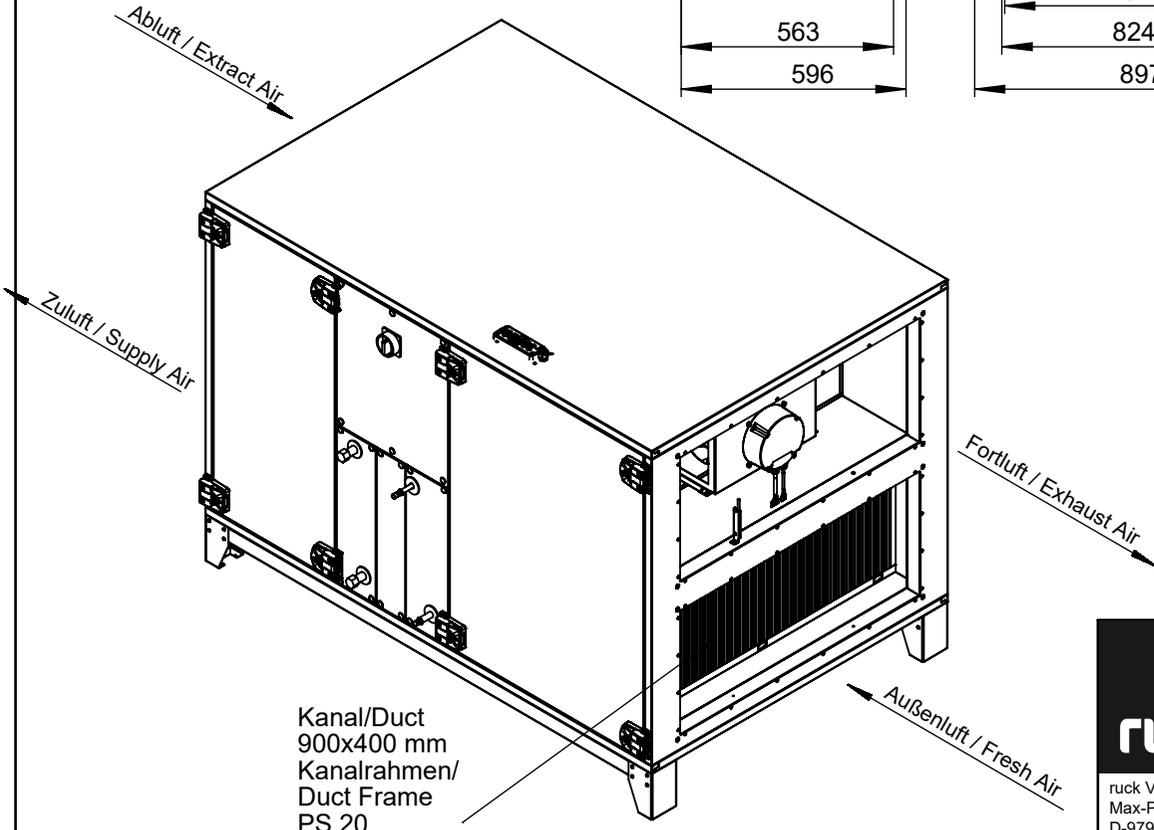


- Ⓜ Anschluss 3/4" Aussengewinde/Connection 3/4" male tread
- Ⓛ1 Kältemitteleinlass 12 / Refrigerant Inlet 12
- Ⓛ2 Kältemitteleinlass 16 / Refrigerant Outlet 16
- Ⓣ Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread



Kanal/Duct
900x400 mm
Kanalrahmen/
Duct Frame
PS 20

		1:20 A4 mm	ROTK3400HWDJL 176005 00
	Protection Mark according to ISO16016	General tolerances DIN ISO 2768-c	
ruck Ventilatoren Max-Planck-Str. 5 D-97944 Boxberg	Created I.benk Drawn I.benk Released I.benk Disabled	16.06.2025 16.06.2025 04.07.2025	