

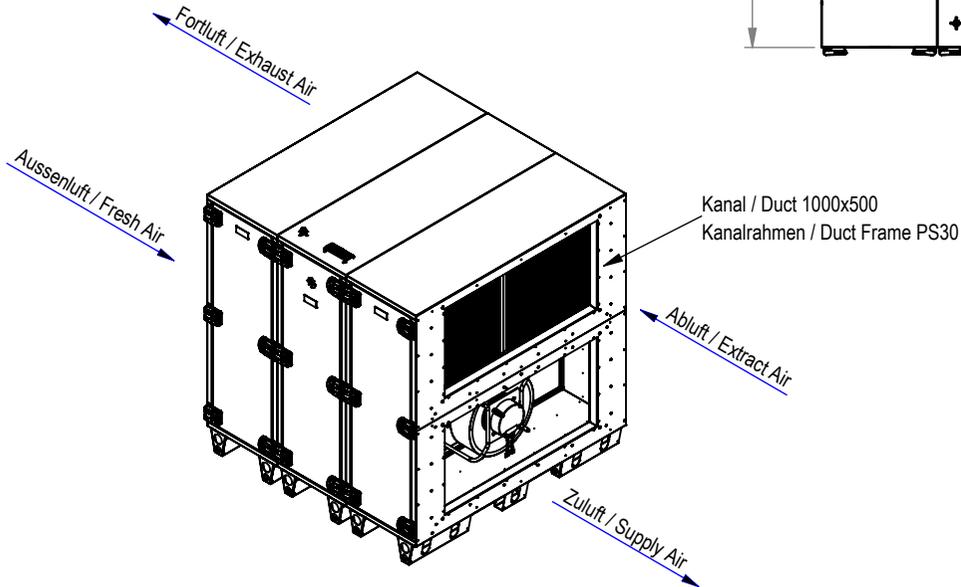


Min. distance for changing the filter 650 mm !!!

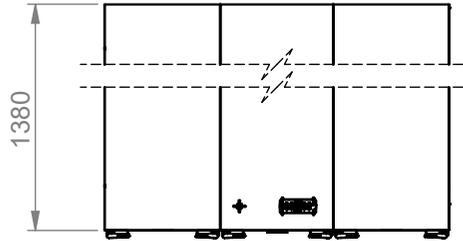

Protection Mark according to ISO16016

Created I.benk  
Drawn I.benk  
Released a.ganea  
Disabled

1:30 A4 mm

General tolerances DIN ISO 2768-c

26.06.2023  
26.06.2023  
10.03.2025

**ROTK5000HOOJRT**

**168202 00**

**ruck**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg