

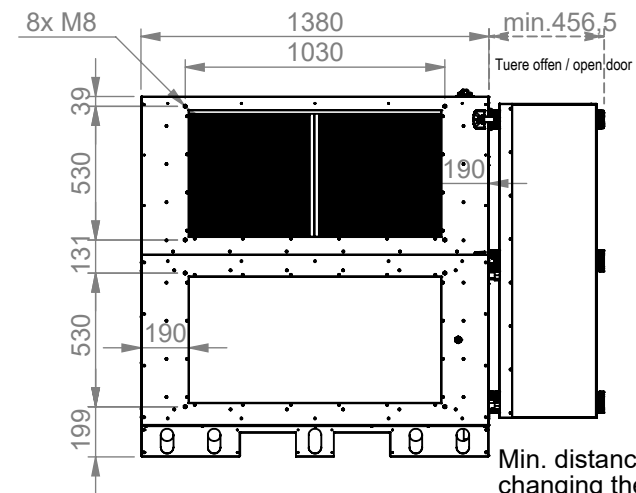
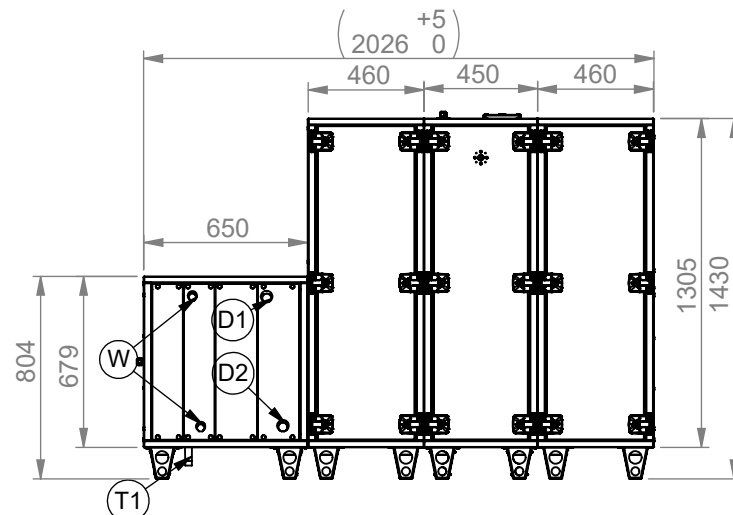
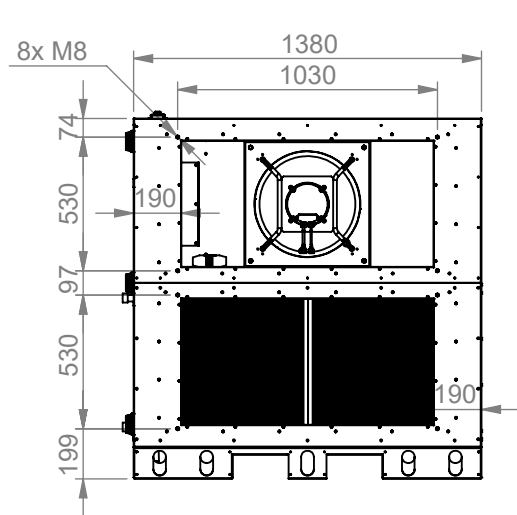


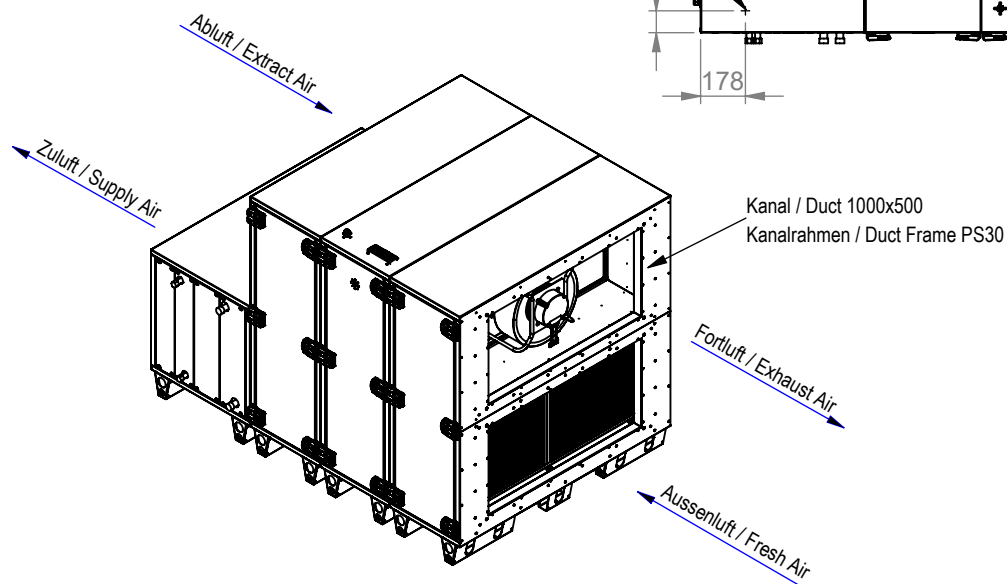


Min. distance for
changing the
filter 650 mm !!!

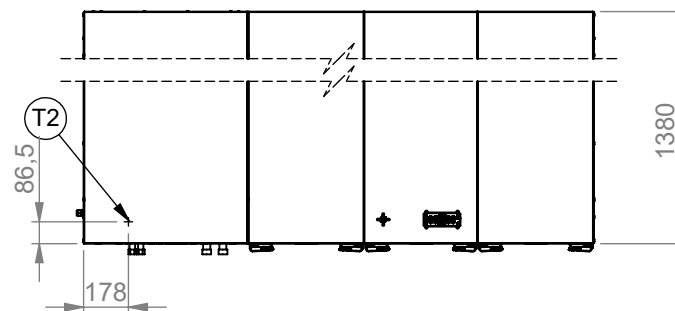

- T1 Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- W Anschluss 3/4" Aussengewinde / Connection 3/4" male tread
- D1 Kältemiteleinlass Ø 28 / Refrigerant Inlet Ø 28
- D2 Kältemiteleinlass Ø 35 / Refrigerant Outlet Ø 35

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg



Protection Mark
according to ISO16016

Created I.benk
Drawn I.benk
Released a.ganea
Disabled

1:30 A4 mm

General tolerances
DIN ISO 2768-c

06.07.2023
06.07.2023
11.03.2025

ROTK5000HWDJLT

168392 00