

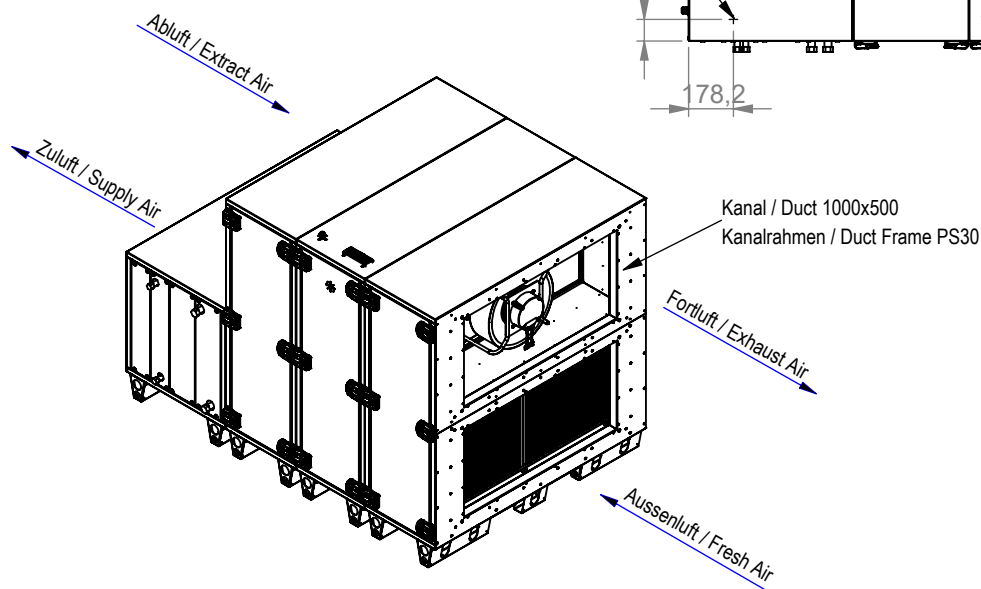
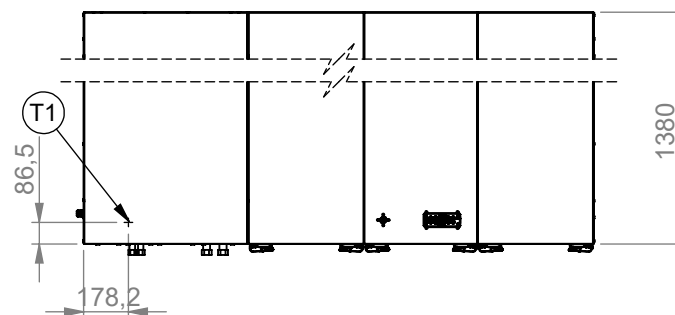
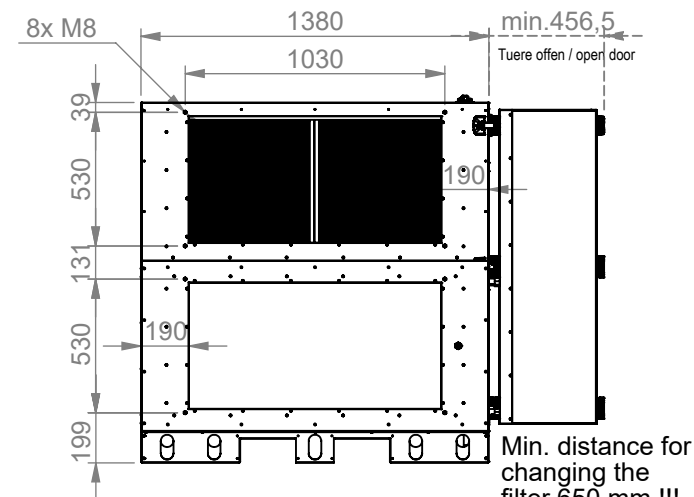


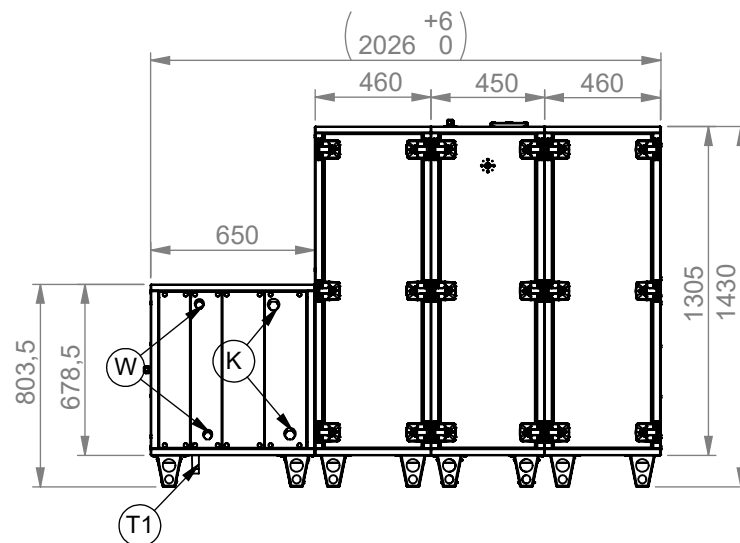

- T1 Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- W Anschluss 3/4" Aussengewinde / Connection 3/4" male tread
- K Anschluss 1" Aussengewinde / Connection 1" male tread

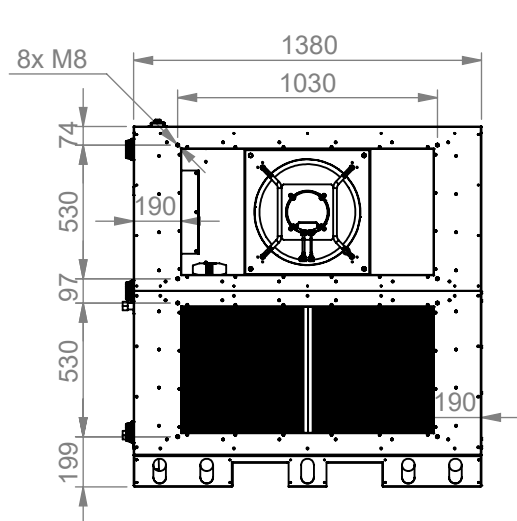

Protection Mark
according to ISO16016

Created I.benk
Drawn I.benk
Released a.ganea
Disabled

1:30 A4 mm

General tolerances
DIN ISO 2768-c

06.07.2023
06.07.2023
11.03.2025

ROK5000HWKJLT

168393 00

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg