



Min. distance for changing the filter 650 mm !!!

⊙ Anschluss 3/4" Aussengewinde / Connection 3/4" male thread

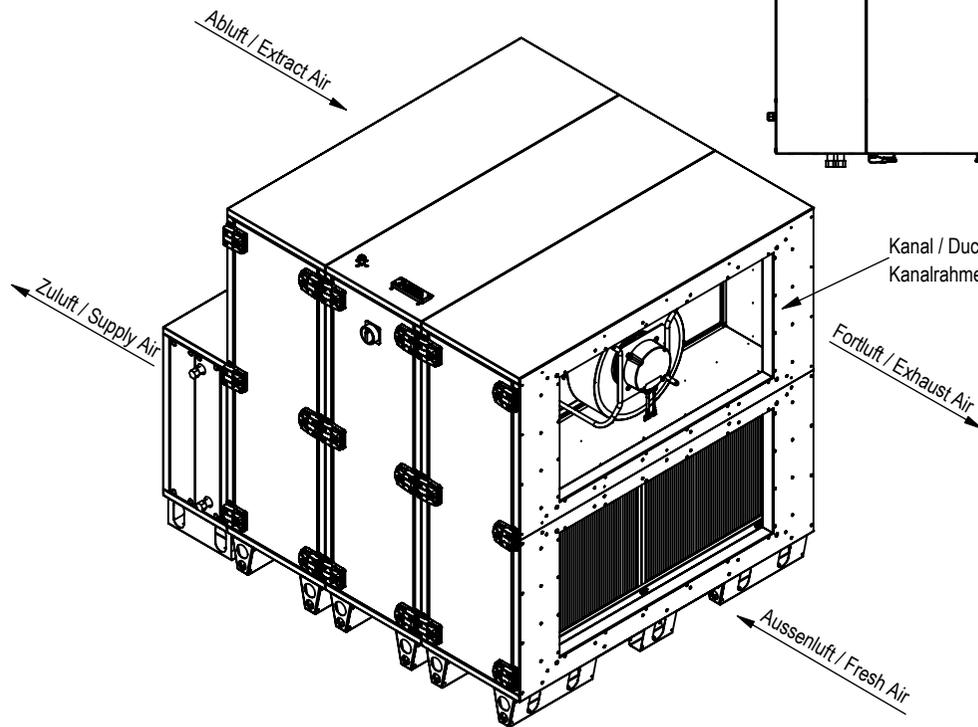

**ruck**  
ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg



1:25 A4 mm

Protection Mark according to ISO16016  
Created I.benk  
Drawn I.benk  
Released I.benk  
Disabled

General tolerances DIN ISO 2768-c  
06.07.2023  
06.07.2023  
11.10.2023

**ROTK5000HWOJLT**

**168391 00**