
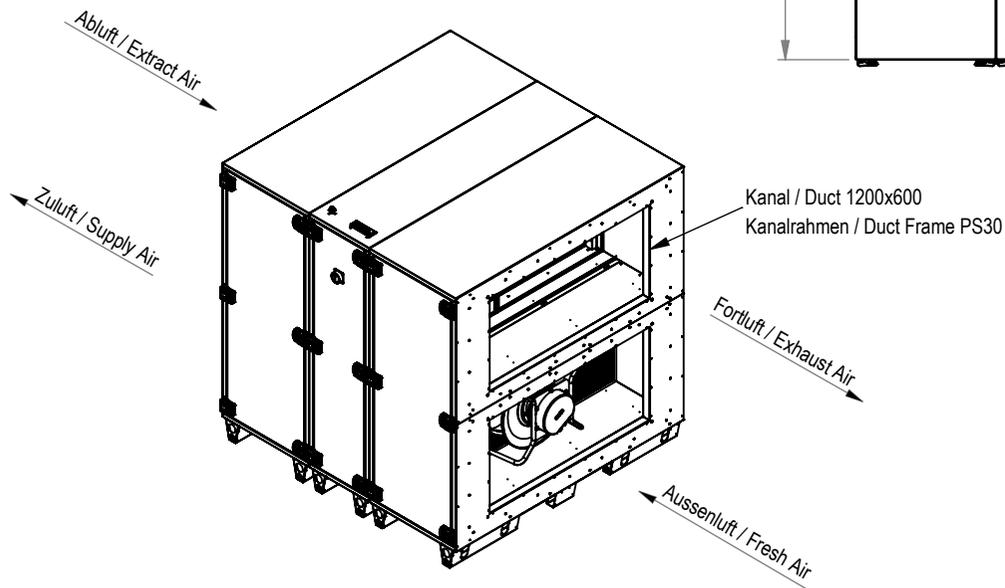


Min. distance for  
changing the  
filter 800mm !!!

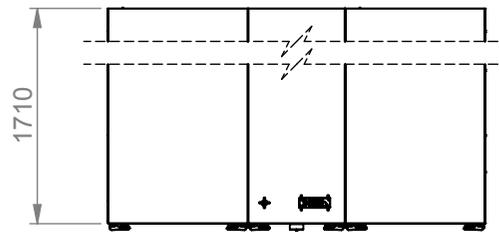

Protection Mark  
according to ISO16016

Created I.benk  
Drawn I.benk  
Released I.benk  
Disabled

1:35 A4 mm

General tolerances  
DIN ISO 2768-c

29.08.2023  
29.08.2023  
16.10.2023

**ROK7600HOOJLT**

**169028 00**

**ruck**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg