




Min. distance for changing the filter 800mm !!!

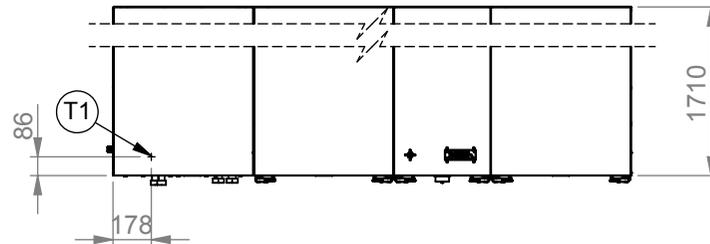

- (T1)** Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W)** Anschluss 1" Aussengewinde / Connection 1" male tread
- (K)** Anschluss 1"-1/4 Aussengewinde / Connection 1"-1/4 male tread

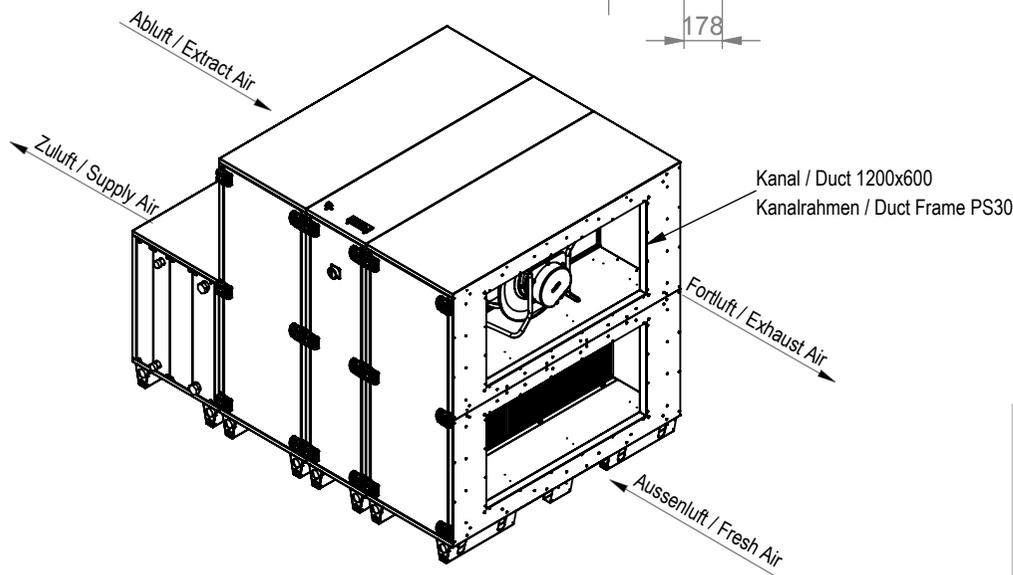

**ruck**  
 ruck Ventilatoren  
 Max-Planck-Str. 5  
 D-97944 Boxberg



Protection Mark according to ISO 16016  
 Created I.benk  
 Drawn I.benk  
 Released I.benk  
 Disabled

1:35 A4 mm

General tolerances according to DIN ISO 2768-c  
 29.08.2023  
 29.08.2023  
 16.10.2023

**ROTK7600HWKJLT**

**169032 00**