

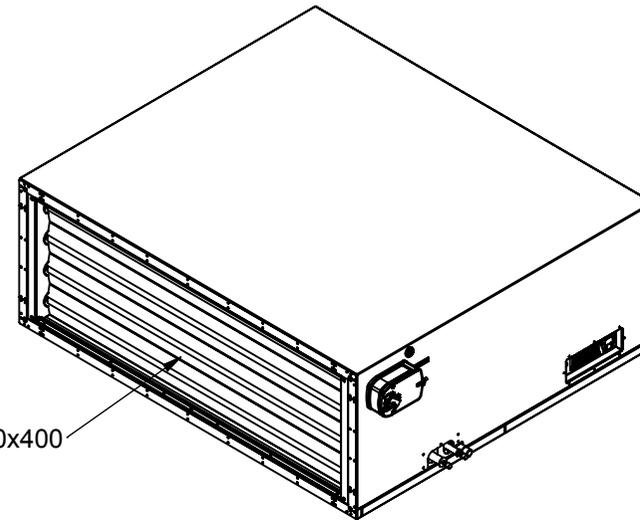


Kondensatablauf 1/2"  
Aussengewinde

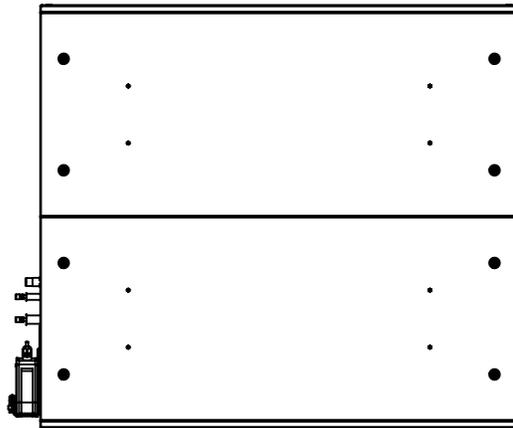

Kanal/Duct 1200x400



1:20 A4 mm

**ruck**

Protection Mark  
according to ISO16016

General tolerances  
DIN ISO 2768-c

**SL12040FODJRF**

ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg

Created d.ursu  
Drawn d.ursu  
Released d.ursu  
Disabled

26.08.2024  
26.08.2024  
18.10.2024

**173070 00**