

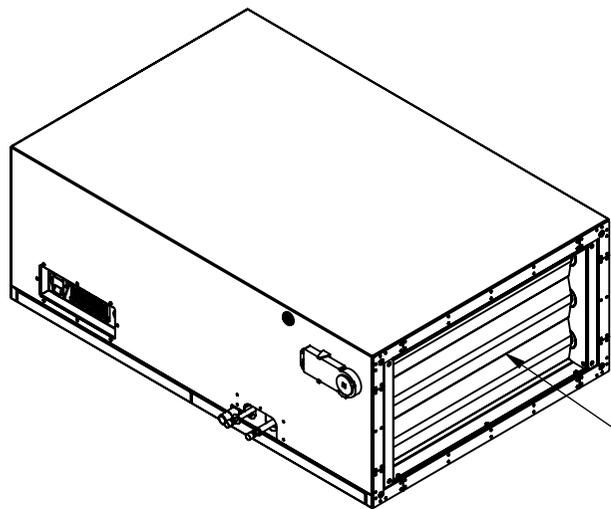


Kondensatablauf 1/2"
Aussengewinde

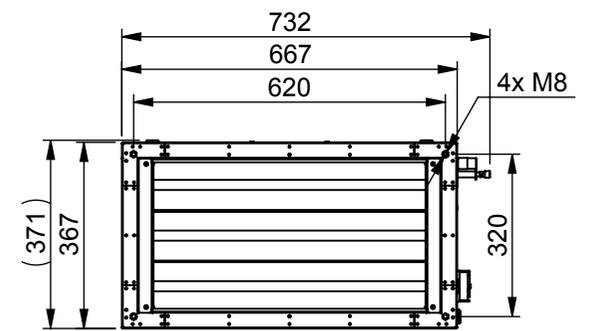

Kanal/Duct 600x300

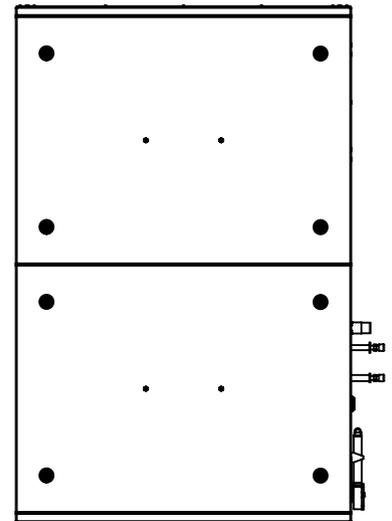

1:15 A4 mm

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Protection Mark
according to ISO16016

Created d.ursu
Drawn d.ursu
Released d.ursu
Disabled

General tolerances
DIN ISO 2768-c

22.10.2024
22.10.2024
22.10.2024

SL6030FODJLP

173466 00