

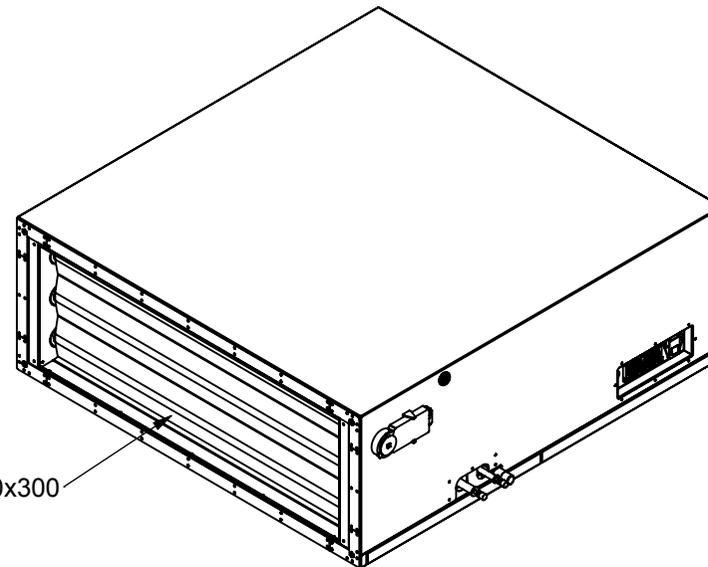
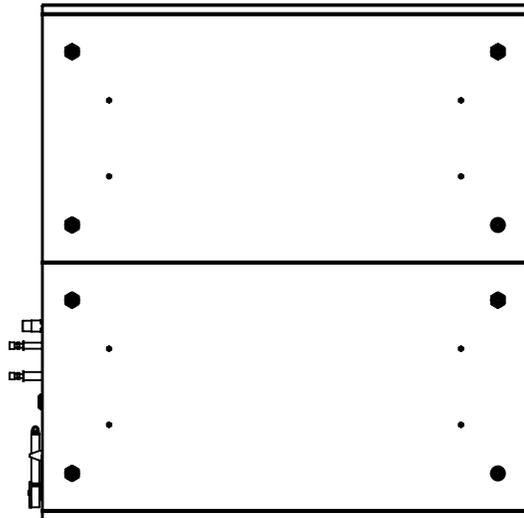


Kondensatablauf 1/2"
Aussengewinde

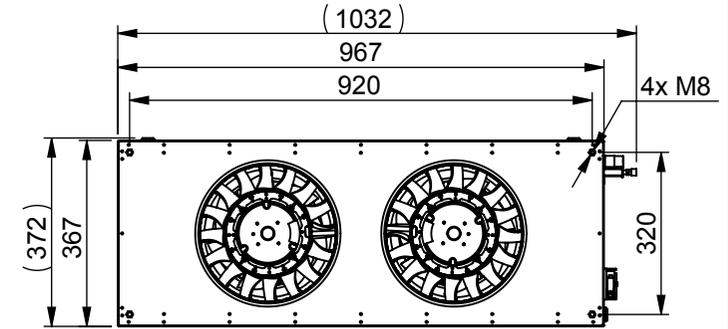

Kanal/Duct 900x300



1:15 A4 mm

ruck

Protection Mark
according to ISO 16016

General tolerances
DIN ISO 2768-c

SL9030FODJRP

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created d.ursu
Drawn d.ursu
Released d.ursu
Disabled

01.08.2024
01.08.2024
18.10.2024

172941 00