
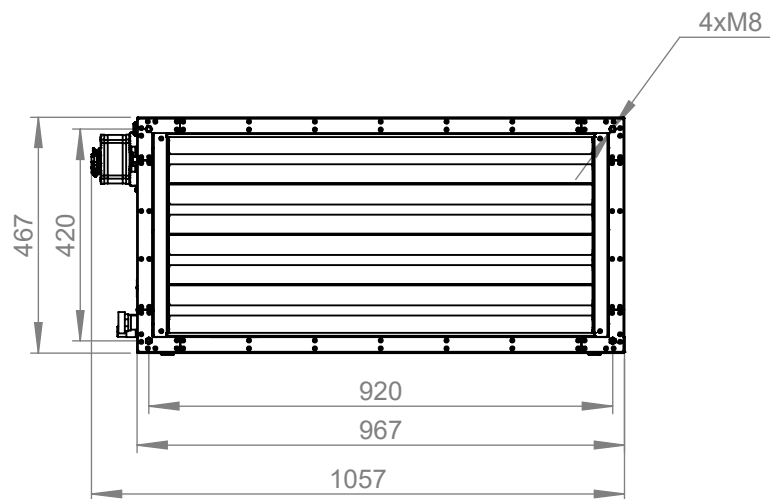


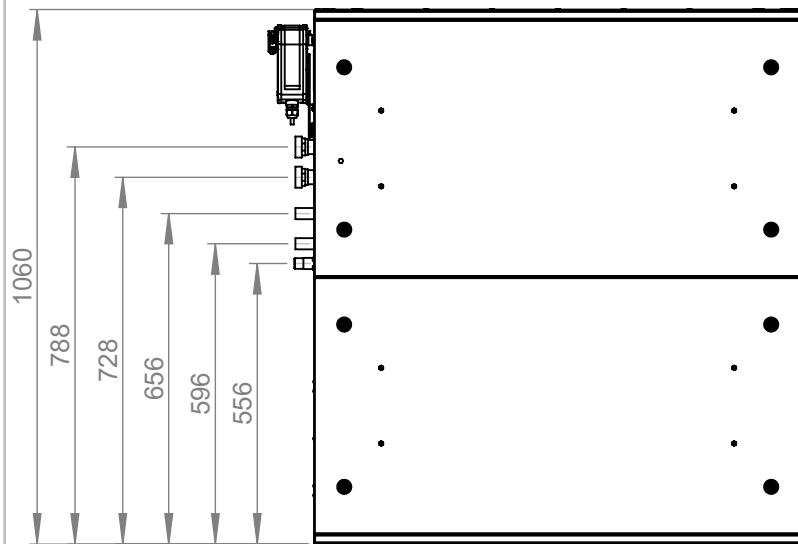


Kondensatablauf 1/2"
Aussengewinde

Anschluss
 $\varnothing$ 22

Anschluss 1 1/4"
Aussengewinde

Kanal/Duct
900x400



1:20 A4 mm

Protection Mark
according to ISO16016

General tolerances
DIN ISO 2768-c

SL09040FWDJLF

Created a.ganea

14.01.2025

Drawn a.ganea

14.01.2025

Released a.ganea

14.01.2025

Disabled

174193 00

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg