

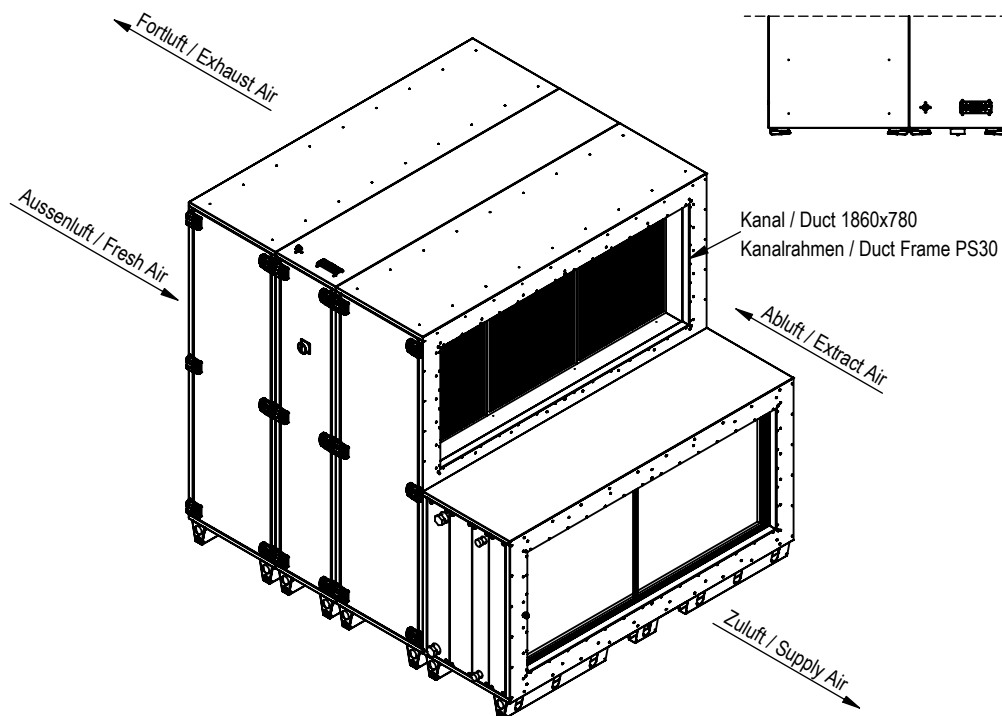
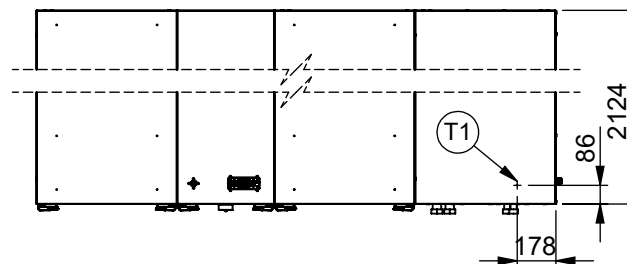
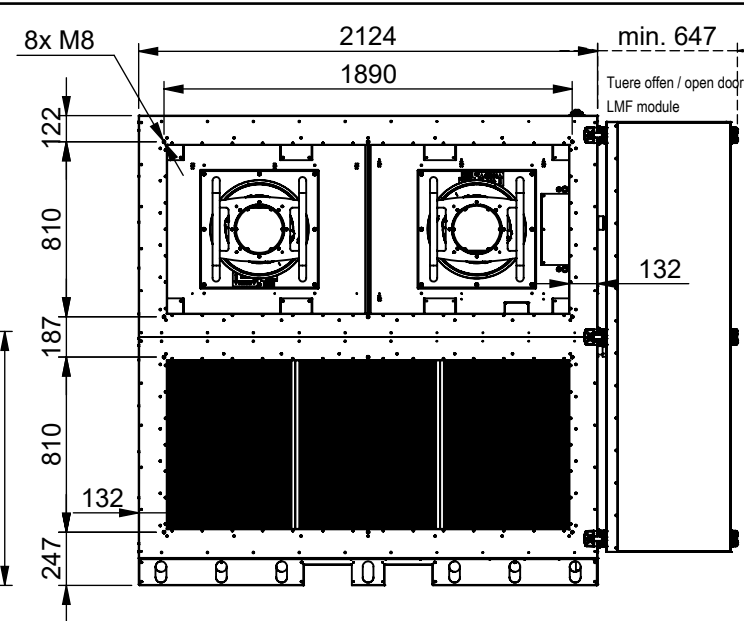
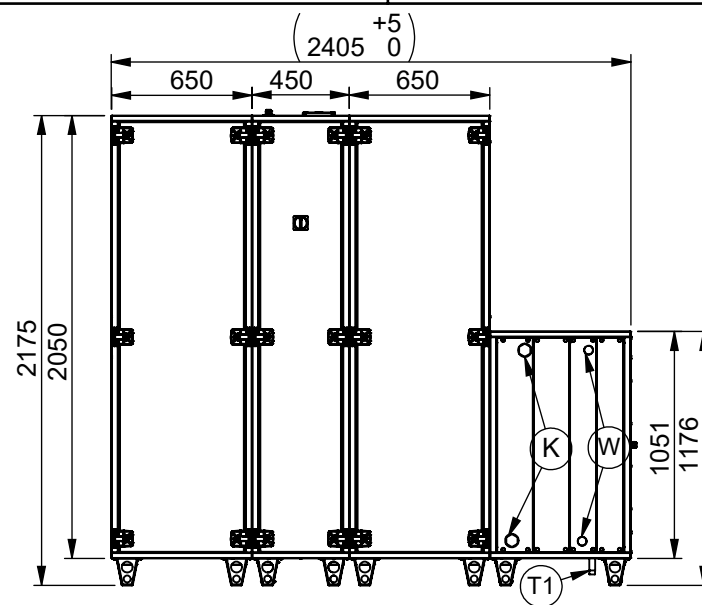


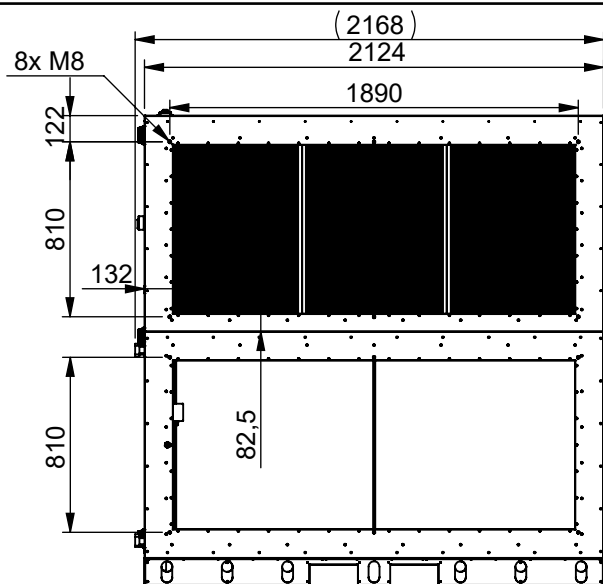

- (T1) Kondensatablauf 3/4" Aussengewinde / Drain 3/4" male tread
- (W) Anschluss 1" Aussengewinde / Connection 1" male tread
- (K) Anschluss 1"-1/4 Aussengewinde / Connection 1"-1/4 male tread



Protection Mark
according to ISO16016

1:35 A4 mm

General tolerances
DIN ISO 2768-c

ruck

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

Created I.benk
Drawn I.benk
Released I.benk
Disabled

07.10.2025
07.10.2025
09.12.2025

ROK16000HWKJRT01

177269 00